

Date:

Saturday 22 Feb 2025

BSUoS Final Tariff: £12.17/MWh






Total Outturn: £15.31m

Daily Balancing Costs



BM Cost (Indicative)

AS Cost (Estimate)

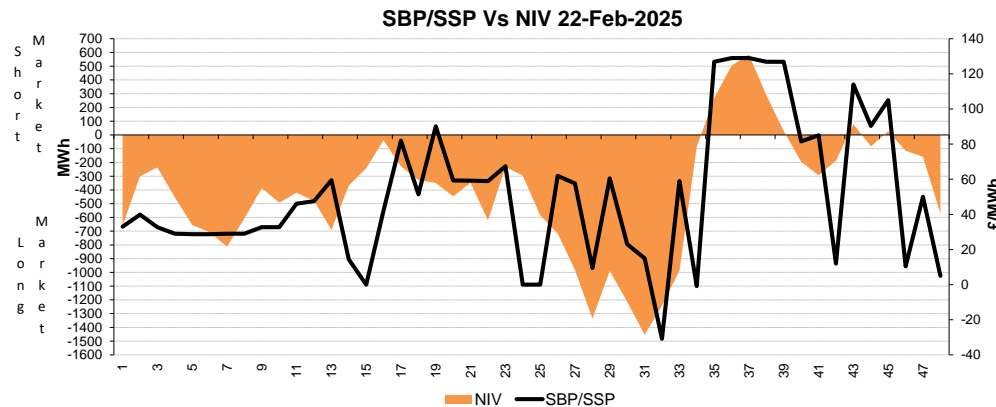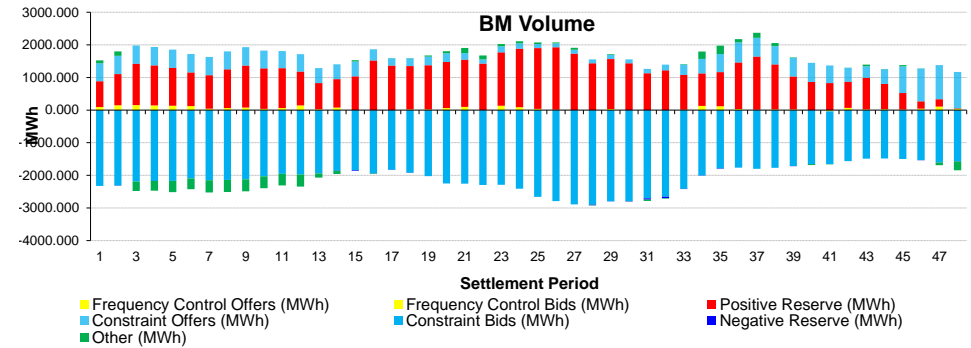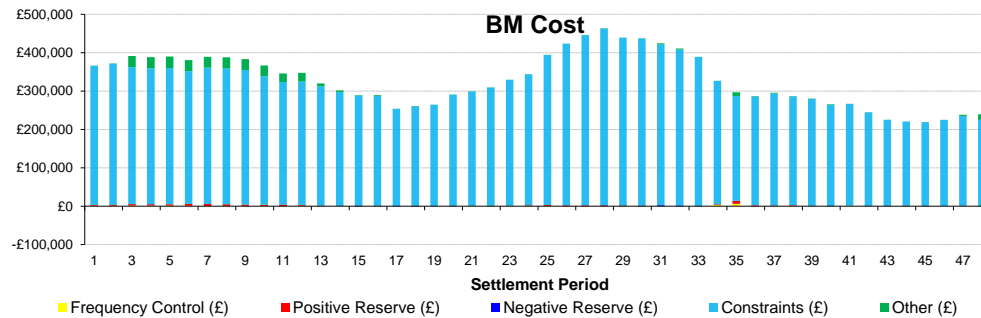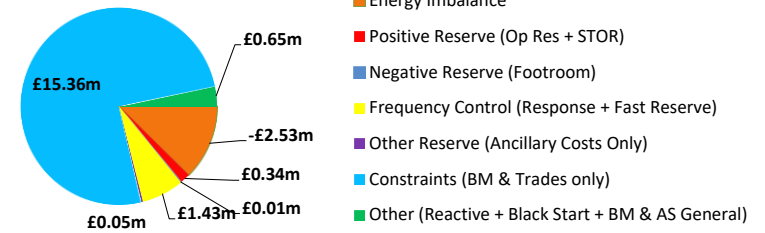

Commentary

The market was predominantly long during the day but there were brief periods of the market being short, it then alternated between short and long during the evening and later hours of the day. Trades were required for Margin. Trades and BM Actions were required to manage thermal constraints in Scotland and England throughout the day. Trades and BM Actions supported Voltage Control. Further BM Actions also supported System Inertia.