

Date:

Sunday 23 Feb 2025

BSUoS Final Tariff: £12.17/MWh



Total Outturn: £23.96m

Daily Balancing Costs






BM Cost (Indicative)

AS Cost (Estimate)

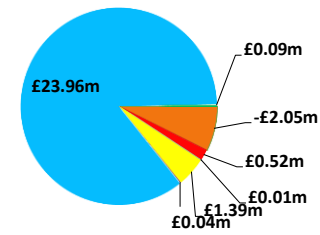

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

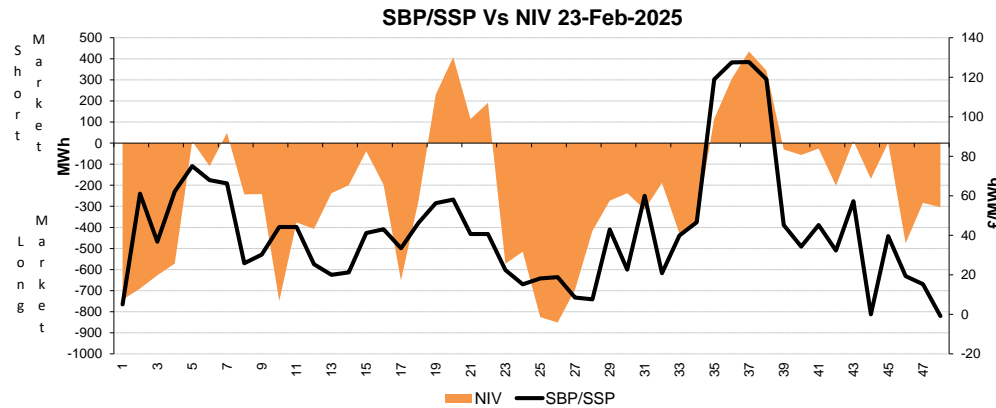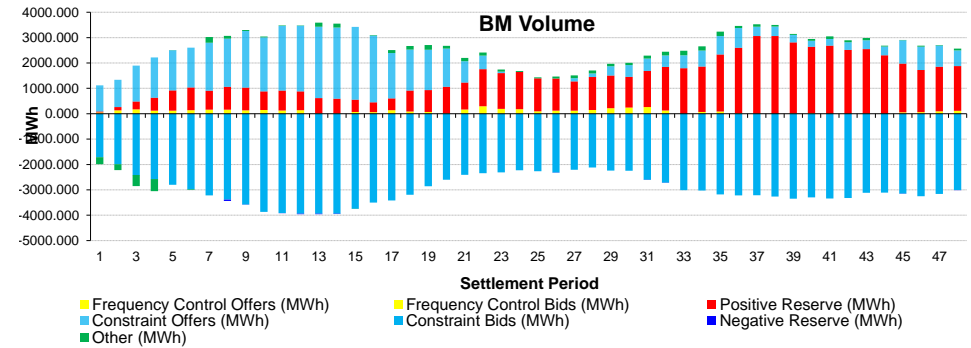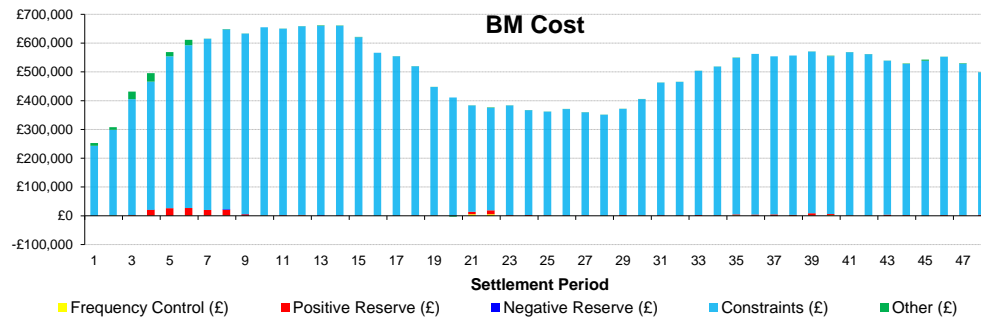

Commentary

The market was long throughout the day with a few short periods from 02:00-02:30, 03:00-03:30, 09:00-11:00, 17:00-19:00 and 21:00-21:30. Trades were required for Downward Margin. Trades and BM Actions were required to manage thermal constraints in Scotland and England throughout the day. Trades and BM Actions supported Voltage Control. Further BM Actions also supported System Inertia.