






Date: Wednesday 02 Apr 2025

BSUoS Final Tariff: £10.74/MWh
Total Outturn: £8.62m

Daily Balancing Costs



- BM Cost (Indicative)
- AS Cost (Estimate)

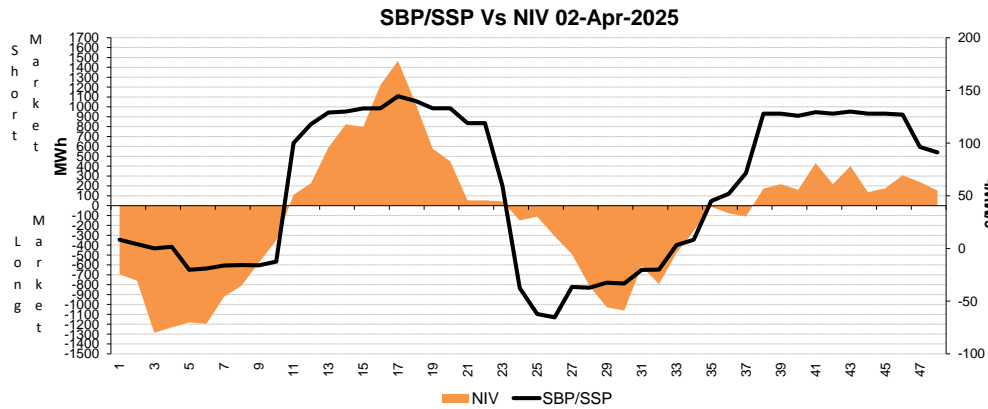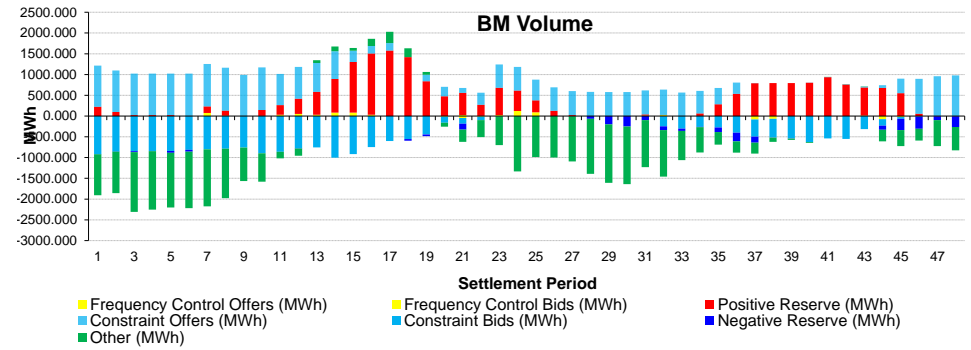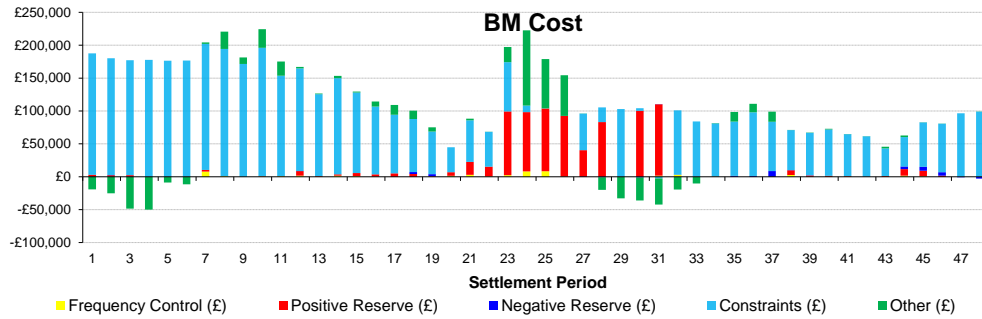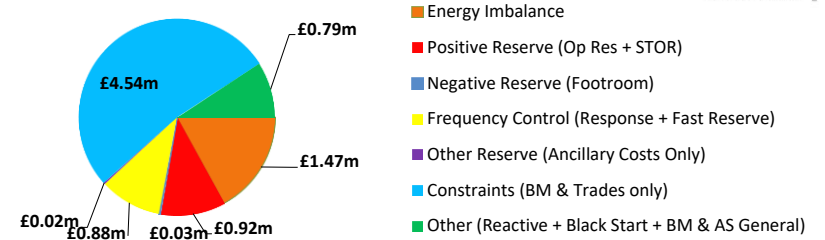

Commentary

The market alternated between long and short during the day. Trades were required for Downward Regulation. BM Actions were required to manage thermal constraints in Scotland throughout the day. BM Actions were also required to support Voltage Control and System Inertia.