






Date: **Saturday 05 Apr 2025**

BSUoS Final Tariff: £10.74/MWh
Total Outturn: £7.99m

Daily Balancing Costs



■ BM Cost (Indicative)
 ■ AS Cost (Estimate)

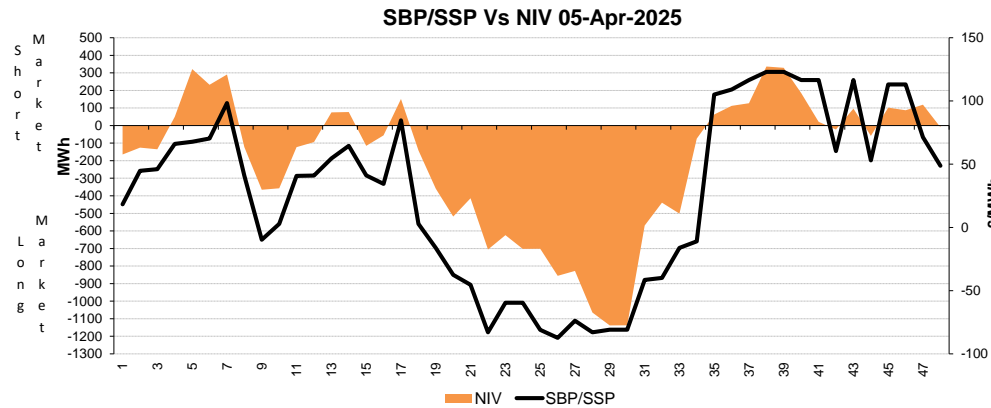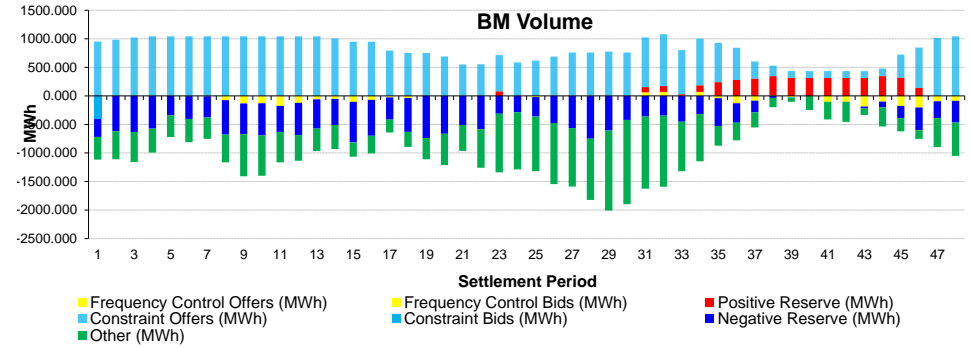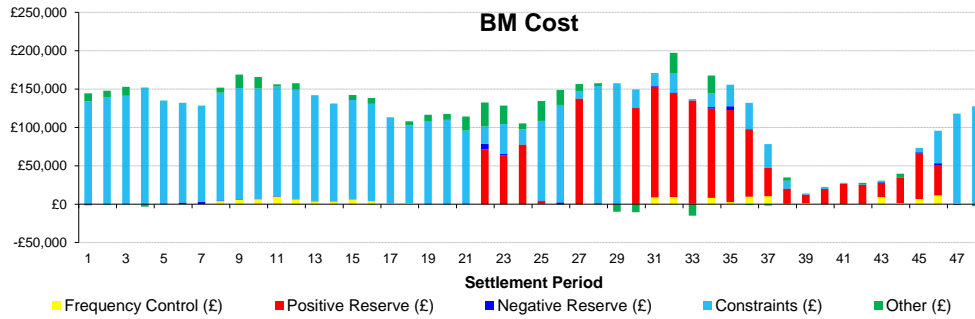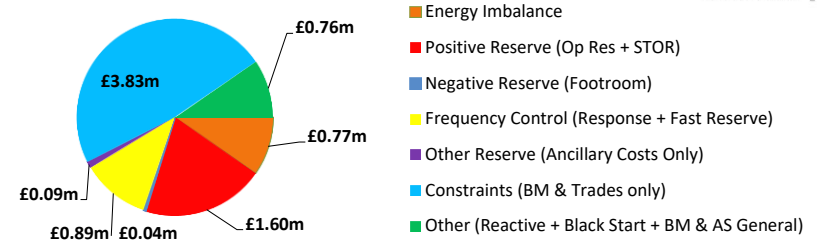

Commentary

The market was long during the daytime and alternated between long and short either side of this. Trades were required for Downward Regulation. BM Actions were required to manage thermal constraints in Scotland at the very start of the day. Trades and BM Actions supported Voltage Control and further BM Actions also supported System Inertia.