



Date: Sunday 04 May 2025

BSUoS Final Tariff: £10.74/MWh
Total Outturn: £9.76m




Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

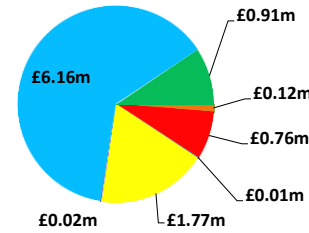

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

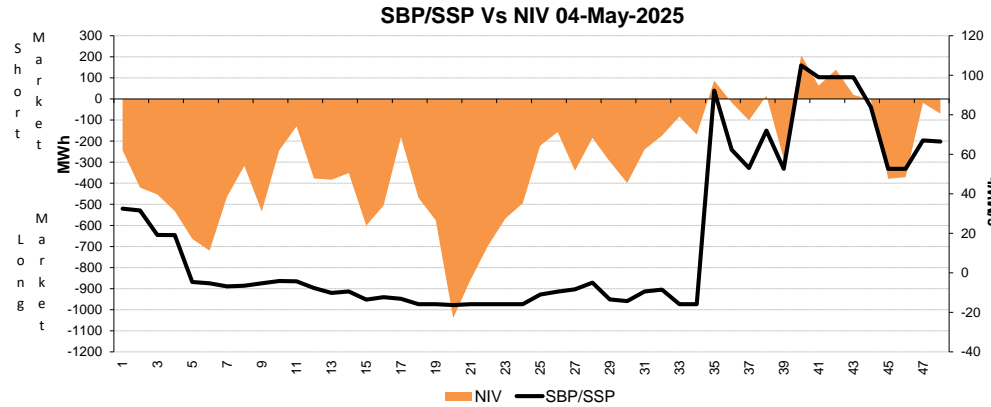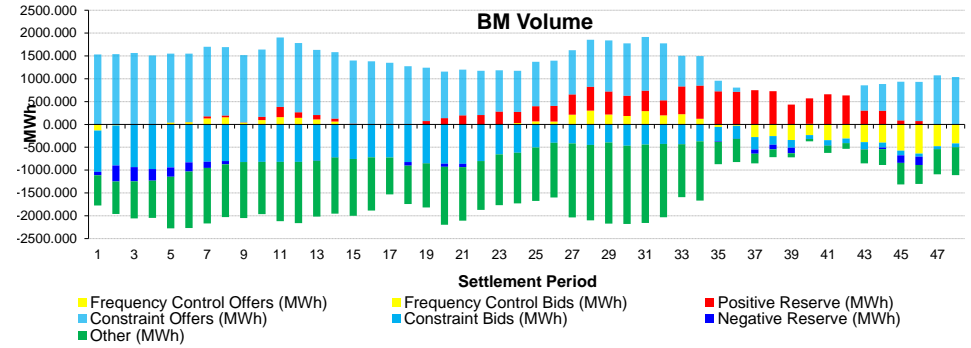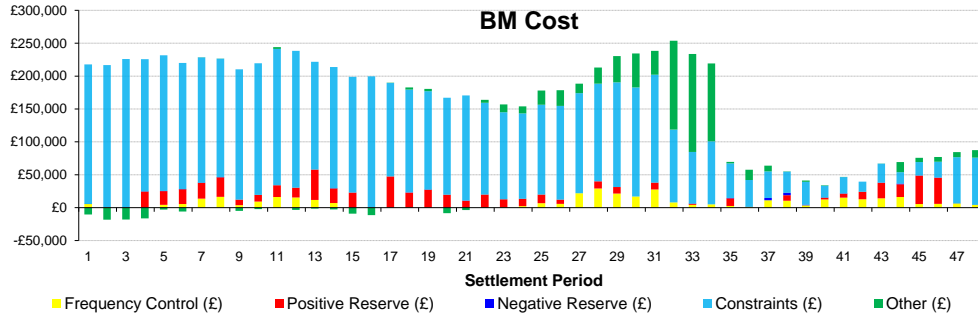

Commentary

The market was long throughout the day, with the only short periods from 17:00-17:30, 18:30-19:00 and 19:30-21:30. Trades were required for Downward Regulation. BM Actions were required to manage thermal constraints in Scotland throughout the day and also in England at the end of the day. Trades and BM Actions supported Voltage Control and further BM Actions supported System Inertia.