






Date: **Saturday 03 May 2025**

**BSUoS Final Tariff: £10.74/MWh**  
**Total Outturn: £11.95m**

# Daily Balancing Costs



■ BM Cost (Indicative)  
 ■ AS Cost (Estimate)

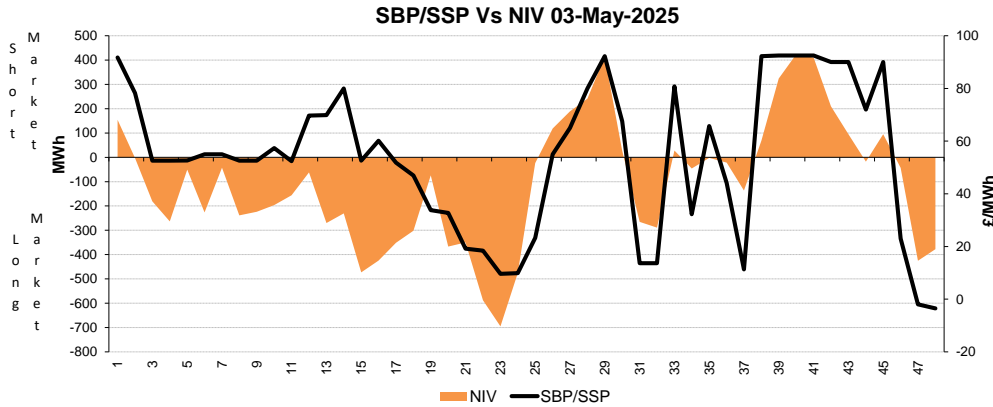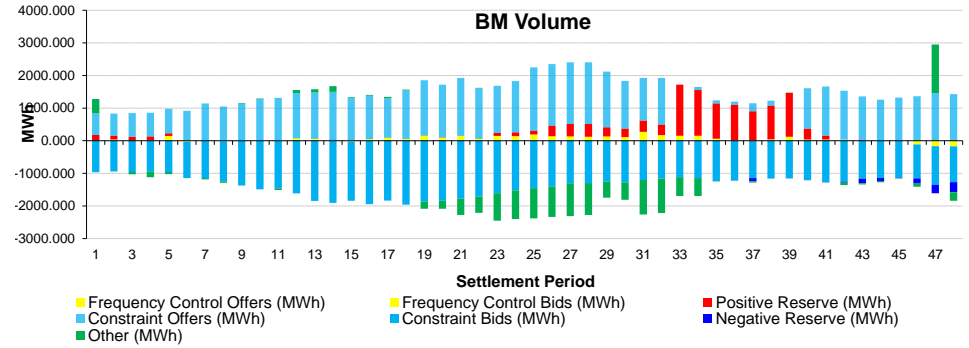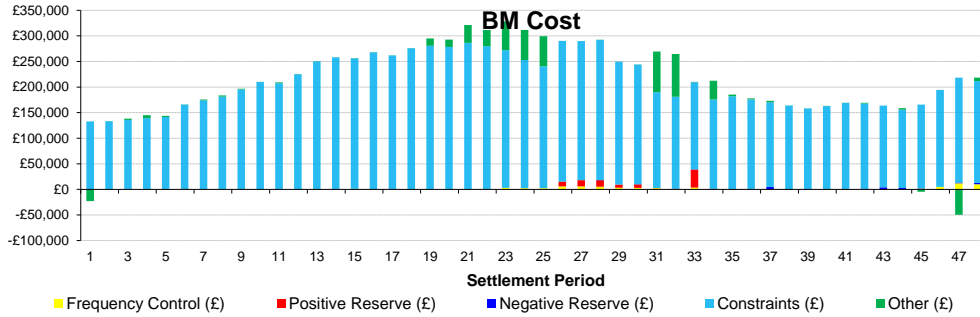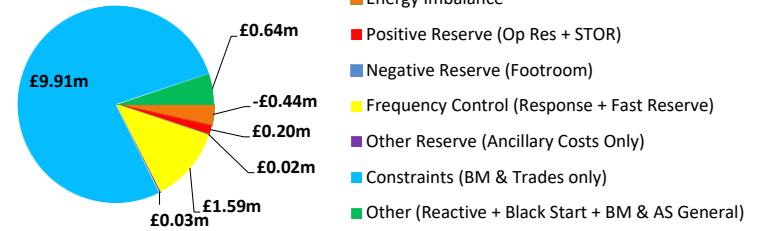

## Commentary

The market was long from 00:30-12:30 and then alternated between long and short throughout the rest of the day. Trades were required for Downward Regulation. BM Actions were required to manage thermal constraints in Scotland/Northern England throughout the day and also in southern England at the beginning of the day. Trades and BM Actions supported Voltage Control and further BM Actions supported System Inertia.