

Date:

Saturday 31 May 2025

BSUoS Final Tariff: £10.74/MWh






Total Outturn: £11.35m

# Daily Balancing Costs



BM Cost (Indicative)

AS Cost (Estimate)

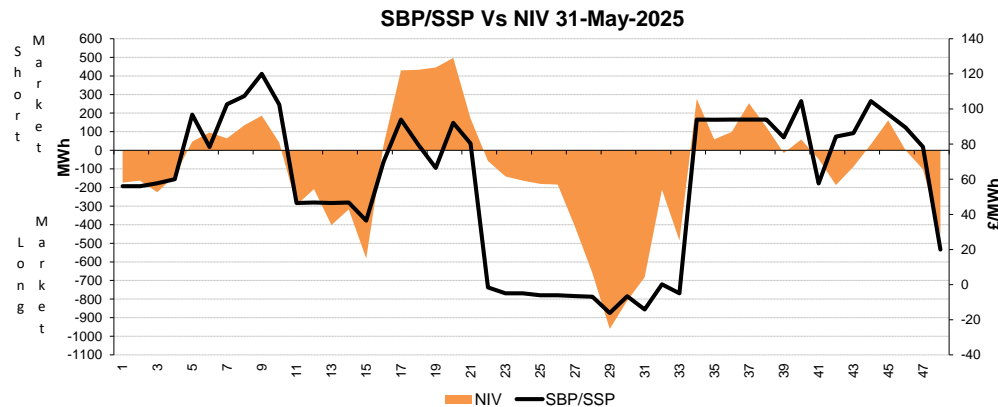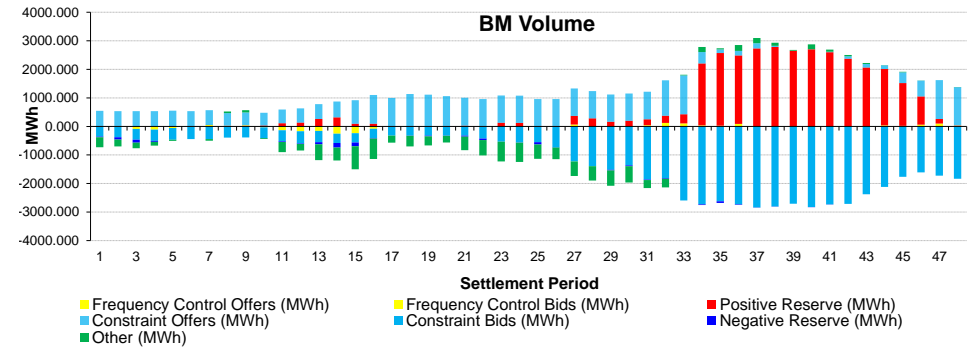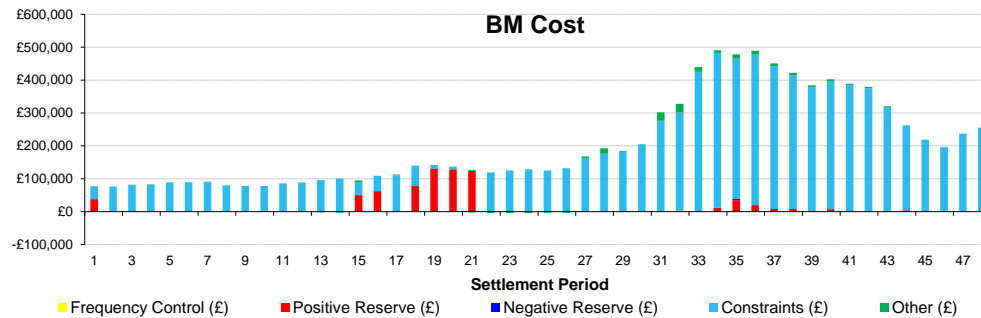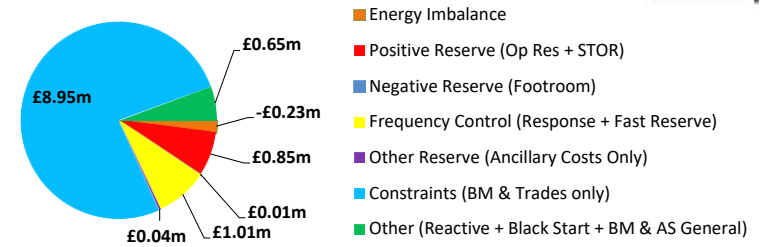

## Commentary

The market alternated between long and short throughout the day. Trades were required for Downward Regulation. BM Actions were required to manage thermal constraints, mostly in Scotland/Northern England/Wales during the second half of the day. Trades and BM Actions supported Voltage Control and further BM Actions supported System Inertia.

Public