
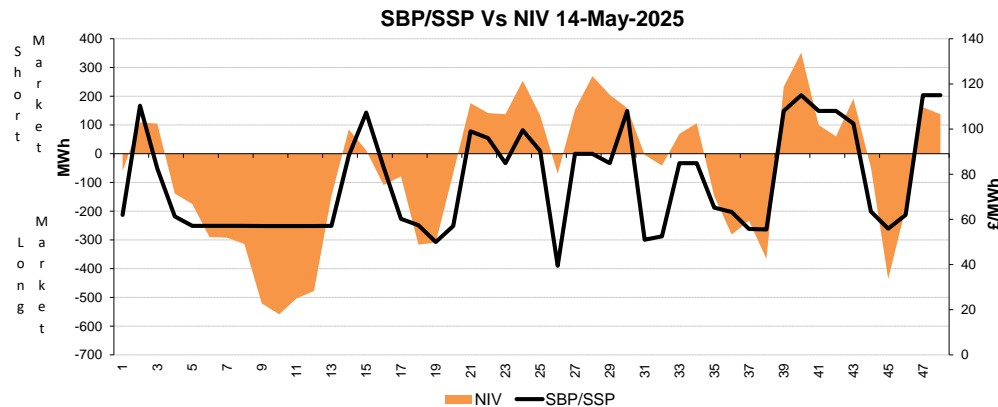
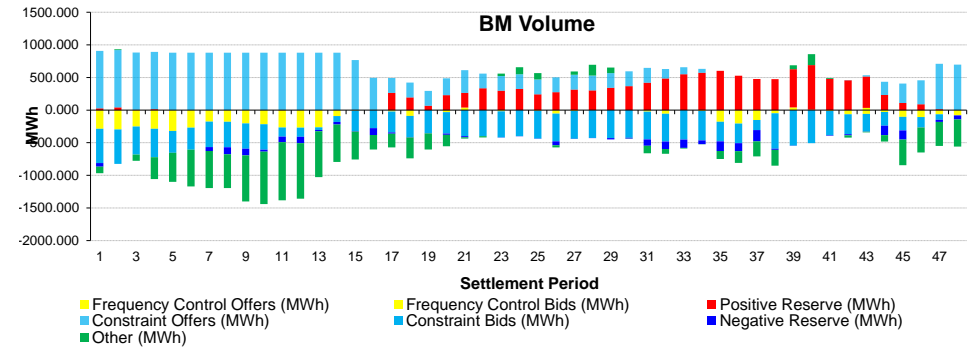
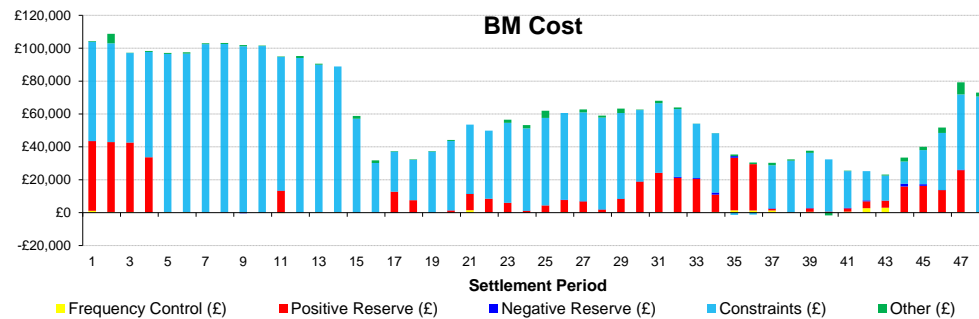
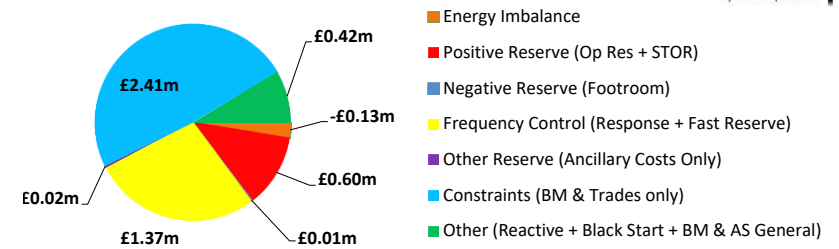


Date: Wednesday 14 May 2025

BSUoS Final Tariff: £10.74/MWh

Total Outturn: £4.70m

Daily Balancing Costs

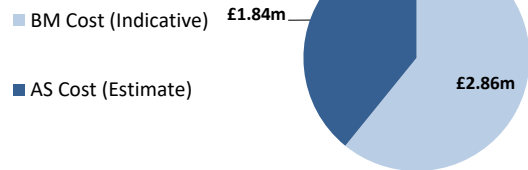

Commentary

The market was alternating between long and short throughout the day. No energy trades were required.

BM Actions were required to manage thermal constraints in England and Wales. Trades and BM Actions supported Voltage Control and further BM Actions supported System Inertia.

Public