

Date: Thursday 05 Jun 2025

BSUoS Final Tariff: £10.74/MWh





Total Outturn: £9.94m

Daily Balancing Costs




BM Cost (Indicative)

AS Cost (Estimate)

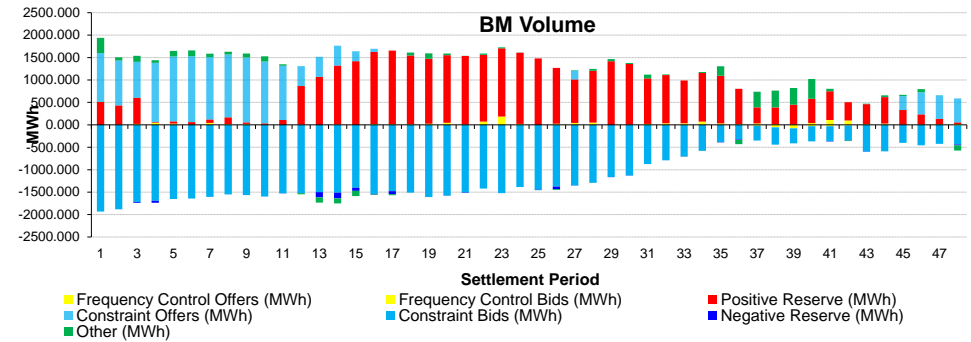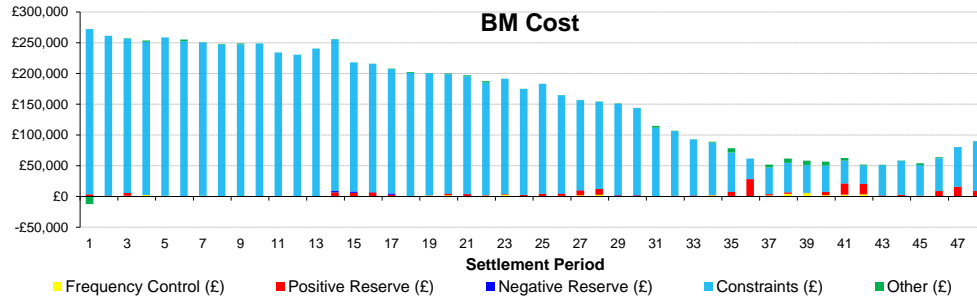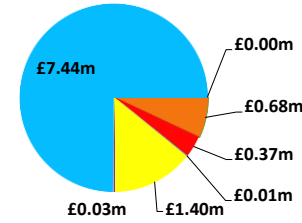

SBP/SSP Vs NIV 05-Jun-2025

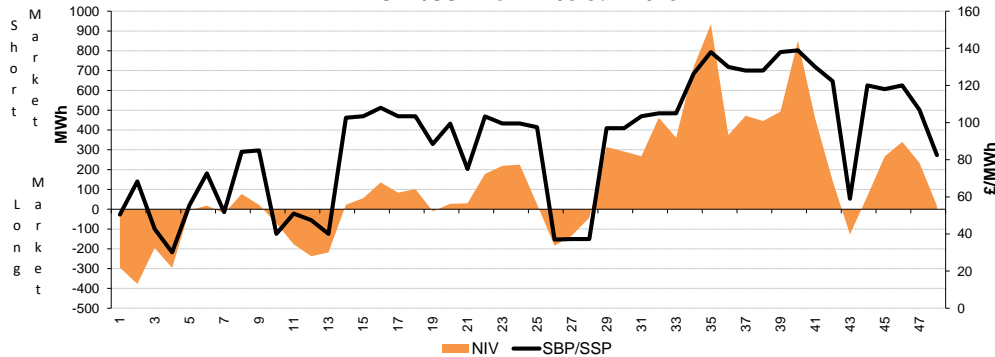

Commentary

The market alternated between long and short throughout the day. Trades were required for Margin.

BM Actions were required to manage thermal constraints in Scotland and Northern England. Trades and BM Actions supported Voltage Control and further BM Actions supported System Inertia.

Public