

Date: Thursday 12 Jun 2025

BSUoS Final Tariff: £10.74/MWh



Total Outturn: £18.35m

Daily Balancing Costs





BM Cost (Indicative)


AS Cost (Estimate)

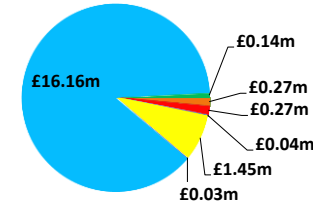

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

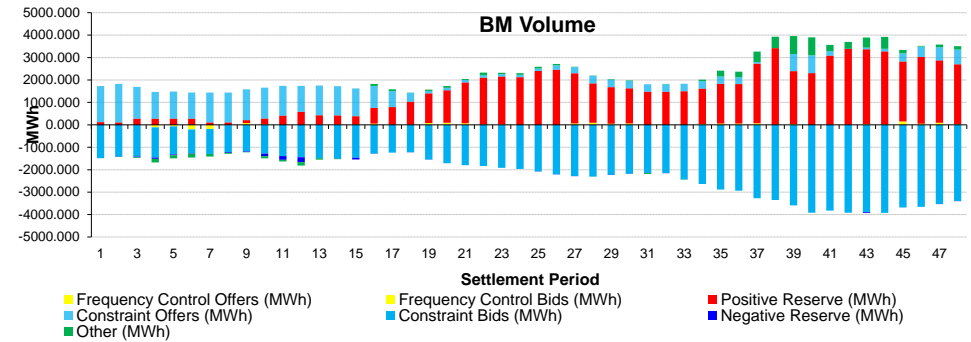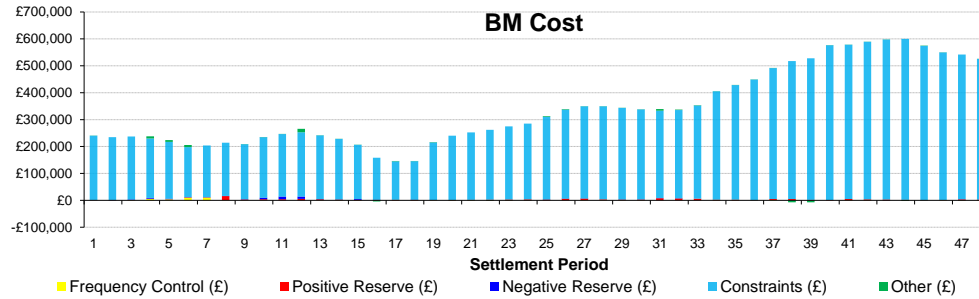

SBP/SSP Vs NIV 12-Jun-2025

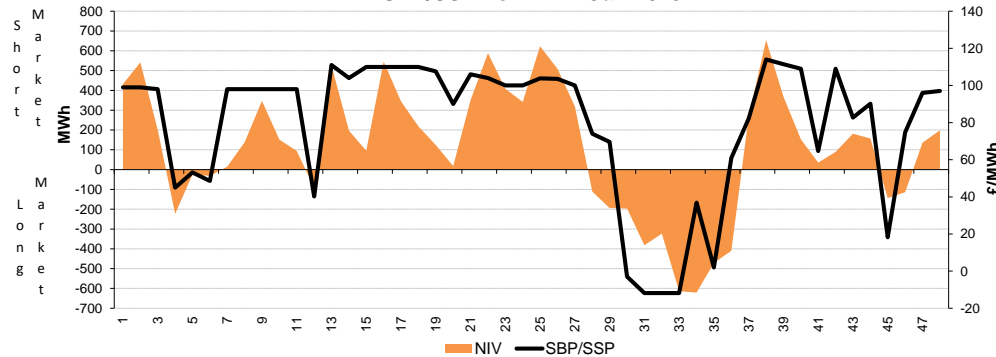

Commentary

The market alternated between long and short throughout the day. Trades were required for Margin.

BM Actions were required to manage thermal constraints in Scotland and Northern England. Trades and BM Actions supported Voltage Control and further BM Actions supported System Inertia.

Public