

Date: Wednesday 04 Jun 2025

BSUoS Final Tariff: £10.74/MWh





Total Outturn: £19.57m

Daily Balancing Costs




BM Cost (Indicative)

AS Cost (Estimate)

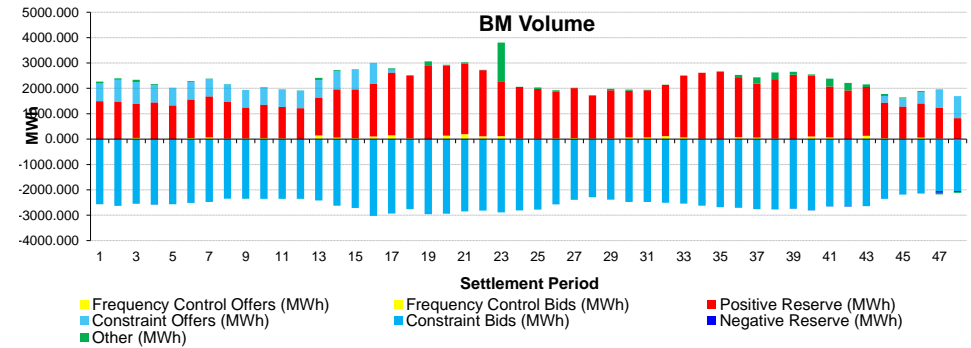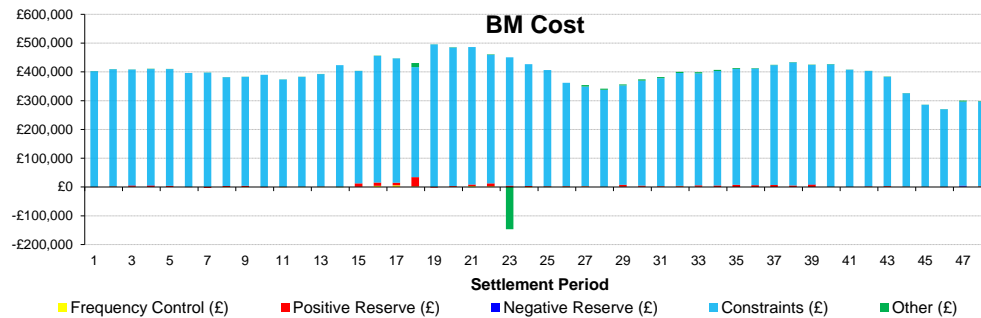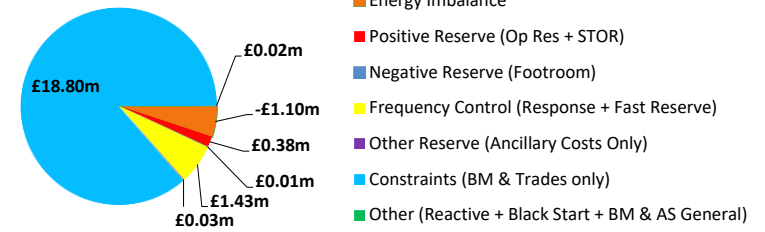

SBP/SSP Vs NIV 04-Jun-2025

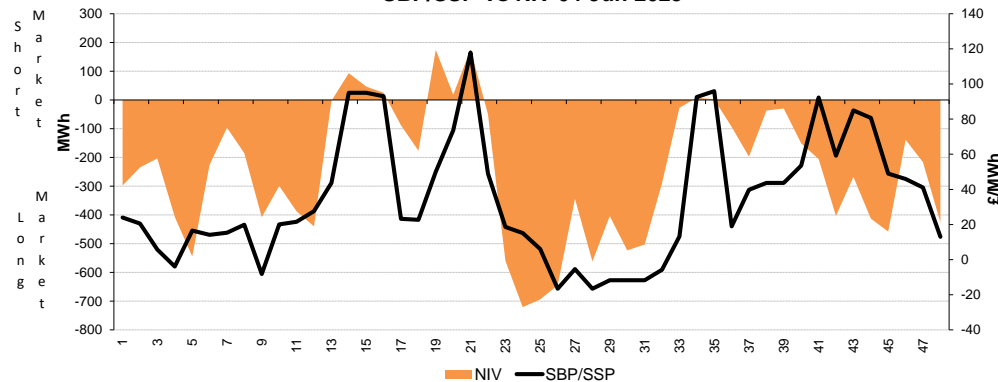

Commentary

The market was long throughout most of the day. Trades were required for Margin. BM Actions were required to manage thermal constraints, predominantly in Scotland/Northern England, throughout the day. Trades and BM Actions supported Voltage Control and further BM Actions supported System Inertia.

Public