

Date:

Monday 23 Jun 2025

BSUoS Final Tariff: £10.74/MWh



Total Outturn: £18.07m

Daily Balancing Costs





BM Cost (Indicative)


AS Cost (Estimate)

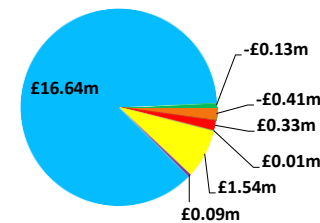

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

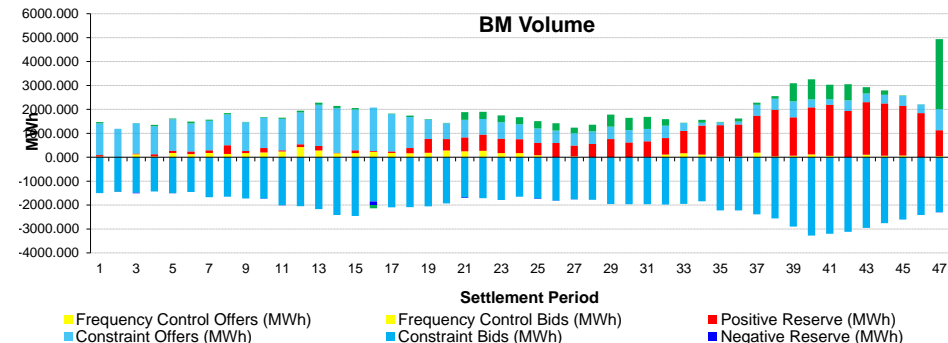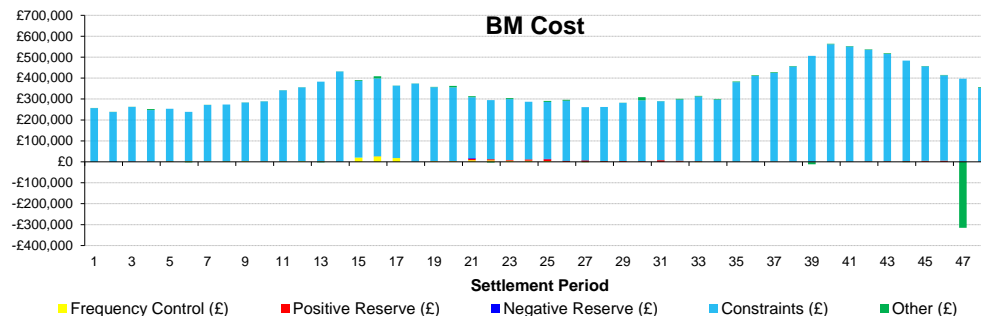

SBP/SSP Vs NIV 23-Jun-2025

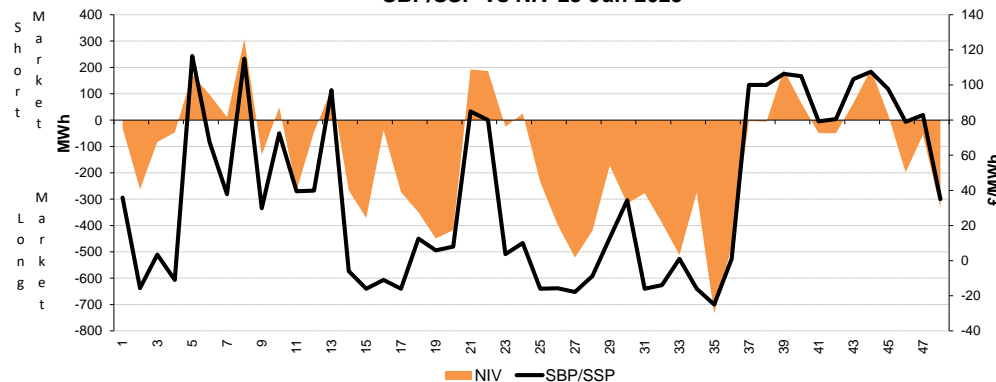

Commentary

The market was mostly long throughout the day, with some occasional short periods. Trades were required for Margin. BM Actions were required to manage thermal constraints across England, Scotland and Wales throughout the day. Trades and BM Actions supported Voltage Control and further BM Actions supported System Inertia.

Settlement Period 47 - Please note SP47 contains data from a SO-SO trade which should be spread over the subsequent settlement periods

Public