

Date:

Sunday 20 Jul 2025

BSUoS Final Tariff: £10.74/MWh

Total Outturn: £6.79m

Daily Balancing Costs



BM Cost (Indicative)

AS Cost (Estimate)

£2.05m

£4.74m

£0.04m




£3.77m

£0.38m

£0.81m

£0.27m

£0.01m

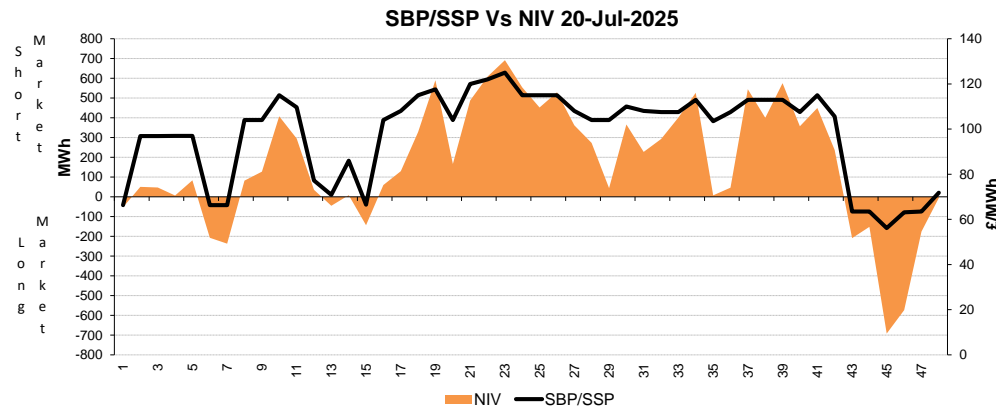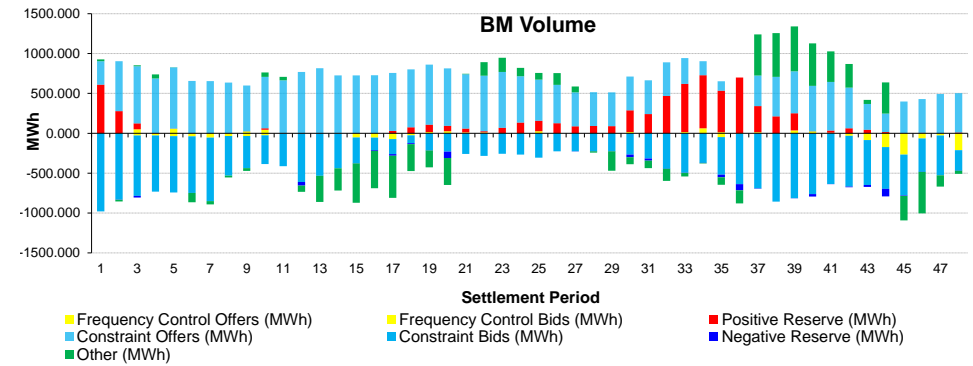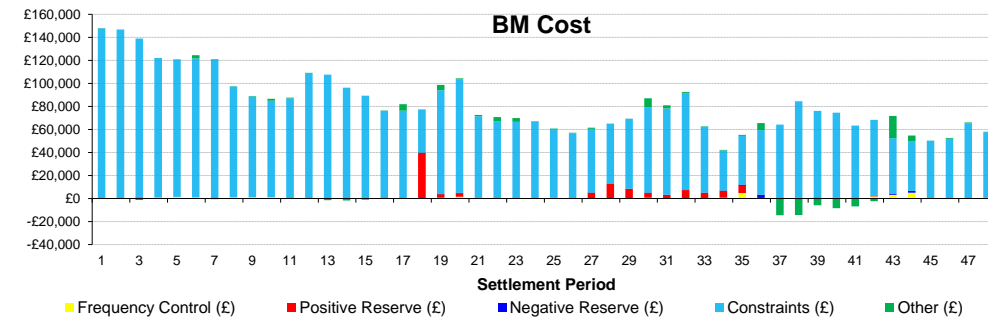

Commentary

The market was predominantly short throughout the day, with some brief long periods between 00:00-00:30, 02:30-03:30, 06:00-06:30, 07:00-07:30 and 21:00-24:00. Trades were required for Margin and Downward Regulation. Trades and BM Actions helped manage thermal constraints in Scotland and England throughout the day. Trades and BM Actions also supported Voltage Control. BM Actions were required for Inertia.

Public