

Date:

Thursday 31 Jul 2025

BSUoS Final Tariff: £10.74/MWh



Total Outturn: £5.02m

Daily Balancing Costs






BM Cost (Indicative)

AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

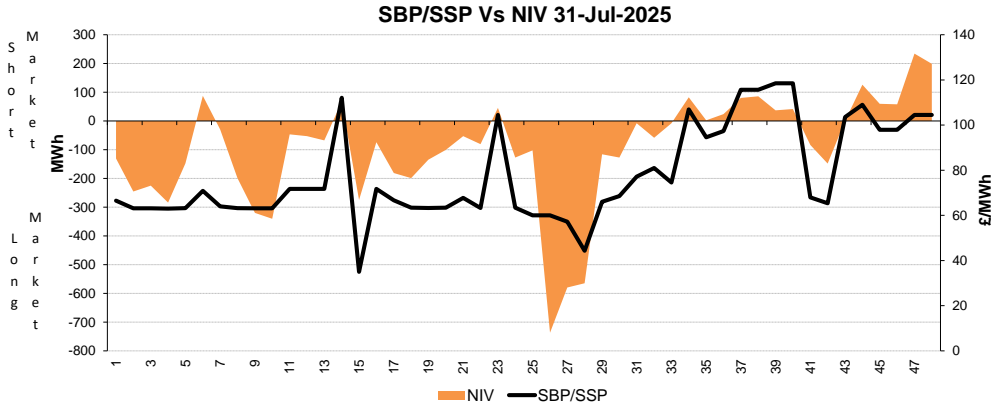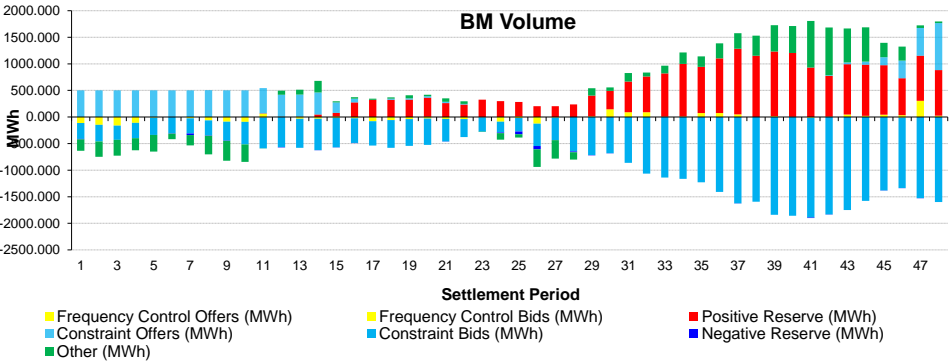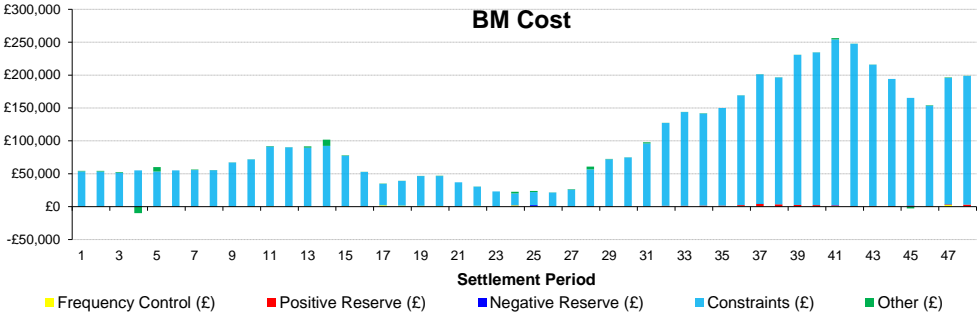

Commentary

The market was predominantly long throughout most of the day, then became short in the evening. Trades were required in the evening for Margin. BM Actions were required to manage thermal constraints in Scotland/Northern England throughout the day. Trades and BM Actions also supported Voltage Control.