

Date: Tuesday 01 Jul 2025

BSUoS Final Tariff: £10.74/MWh



Total Outturn: £7.63m

Daily Balancing Costs





BM Cost (Indicative)


AS Cost (Estimate)

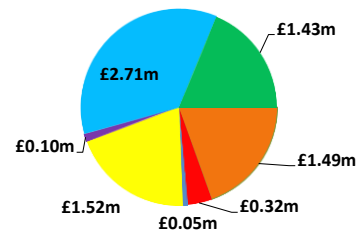

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

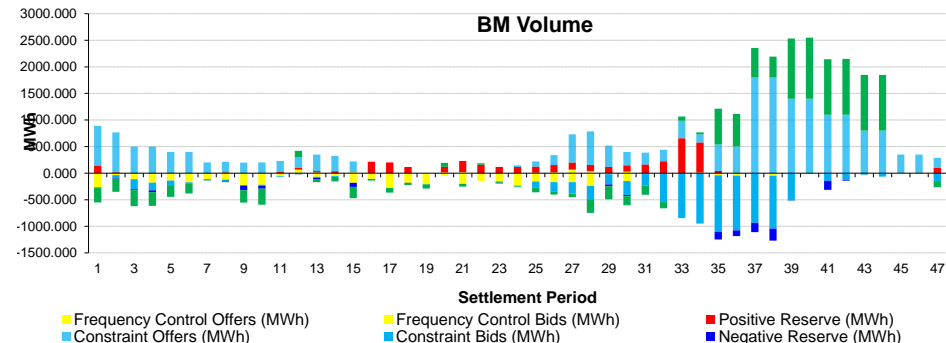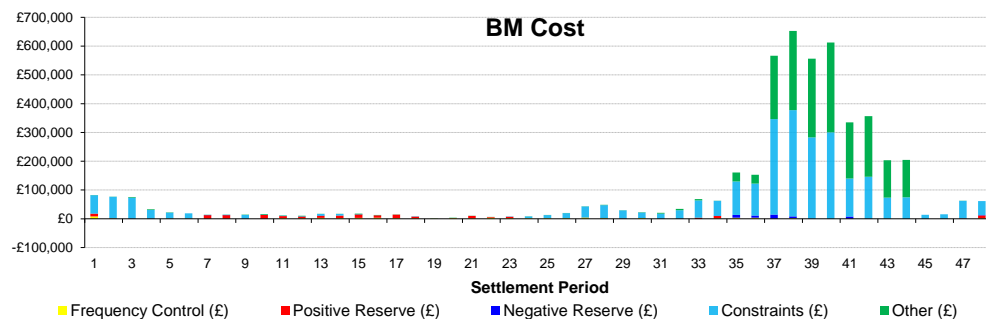

SBP/SSP Vs NIV 01-Jul-2025

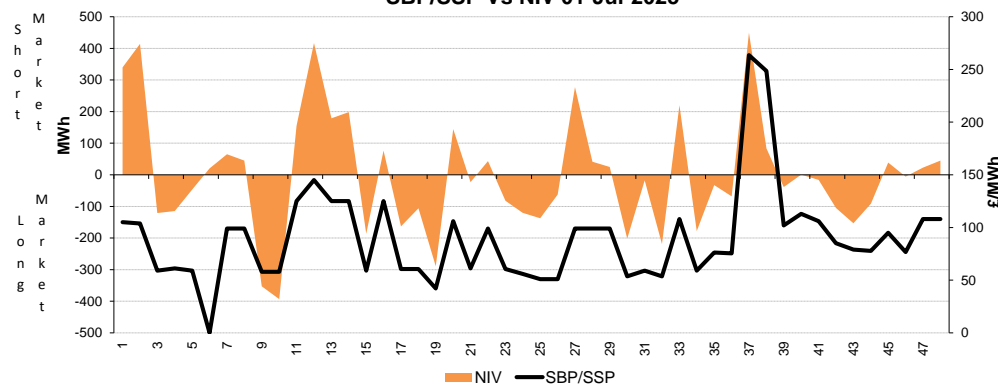

Commentary

The market alternated frequently between long and short throughout the day. Trades were required for Margin. Trades and BM Actions helped to manage thermal constraints across the country at various points throughout the day. BM Actions also supported Voltage Control.

Public