

Date: Monday 07 Jul 2025

BSUoS Final Tariff: £10.74/MWh



Total Outturn: £10.56m

Daily Balancing Costs






BM Cost (Indicative)

AS Cost (Estimate)

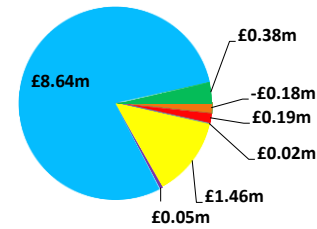

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

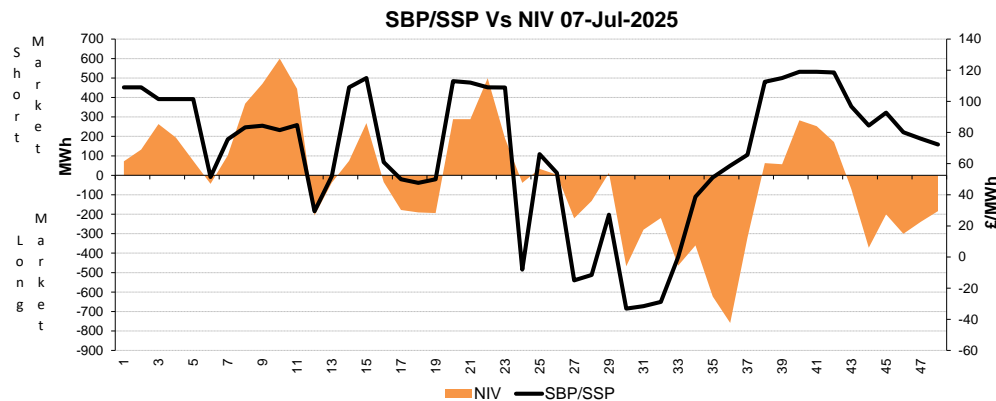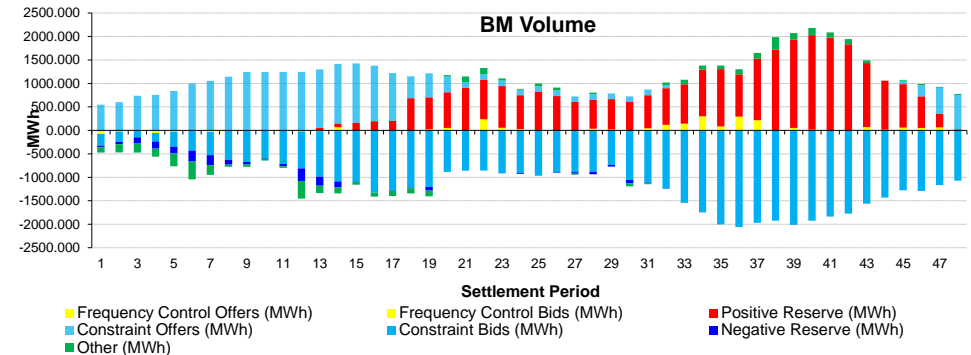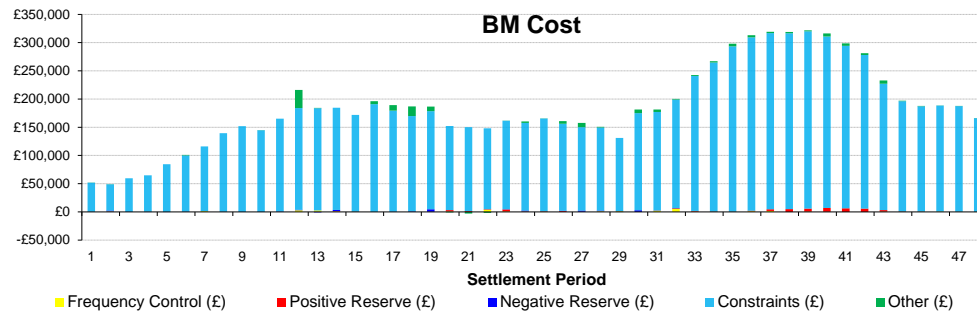

Commentary

The market alternated frequently between long and short throughout the day. Trades and BM Actions helped to manage thermal constraints across Scotland throughout the day and southern England through mid-afternoon. BM Actions were taken to support Voltage Control and System Inertia.

Public