

Date:

Saturday 12 Jul 2025

BSUoS Final Tariff: £10.74/MWh

Total Outturn: £3.68m

Daily Balancing Costs






BM Cost (Indicative)


AS Cost (Estimate)

£2.08m

£1.60m

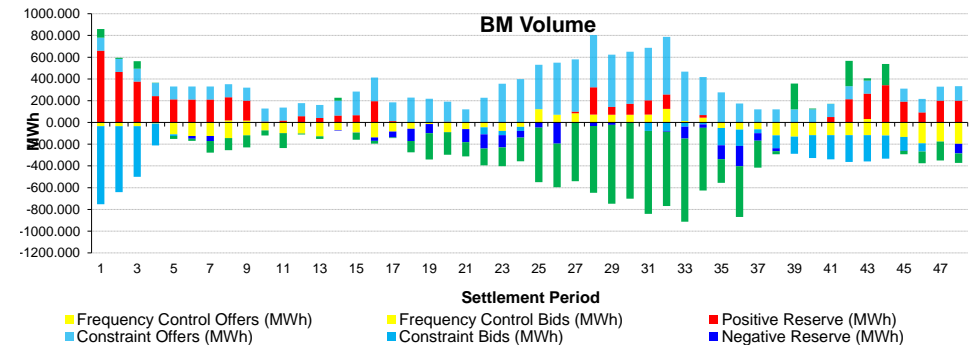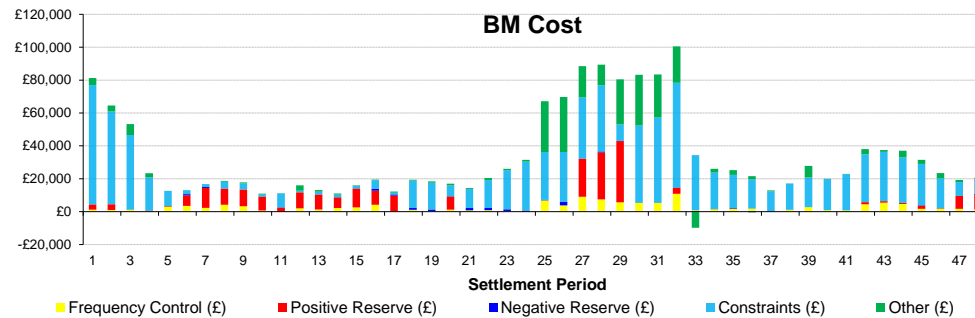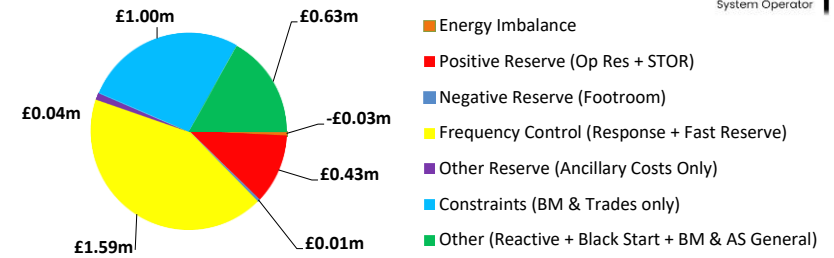

SBP/SSP Vs NIV 12-Jul-2025

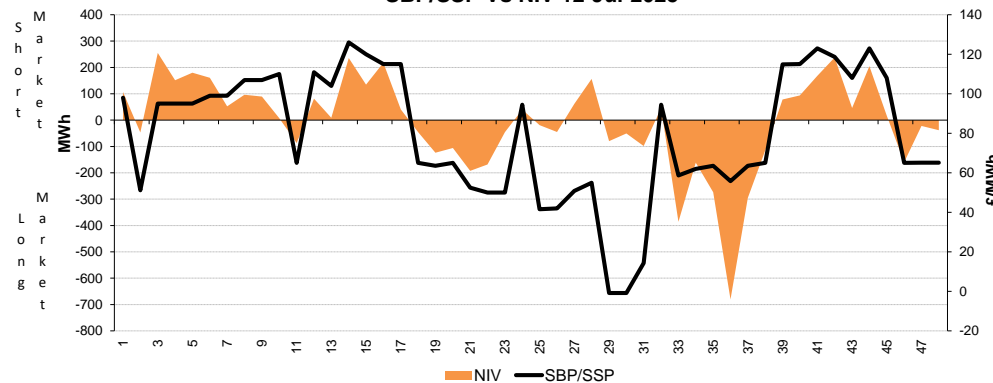

Commentary

The market alternated between long and short throughout the day. Trades were required for Downward Regulation. BM Actions helped to manage thermal constraints in Scotland at the beginning and towards the end of the day. Trades and BM Actions supported Voltage Control. Further BM Actions supported System Inertia.

Public