

Date: Wednesday 16 Jul 2025

BSUoS Final Tariff: £10.74/MWh

Total Outturn: £3.42m

Daily Balancing Costs







BM Cost (Indicative)


AS Cost (Estimate)

£1.98m

£1.44m

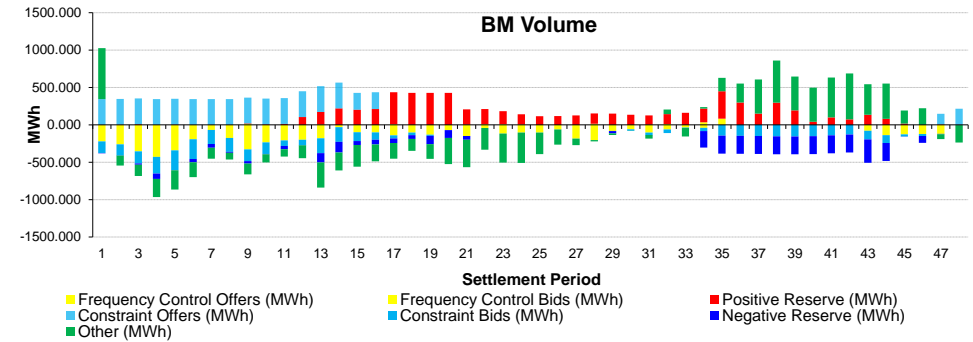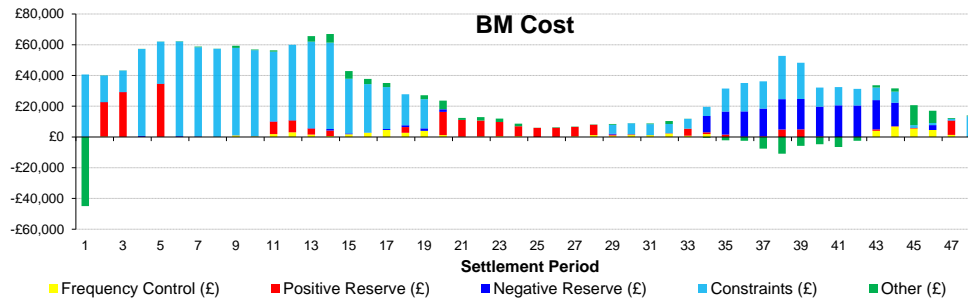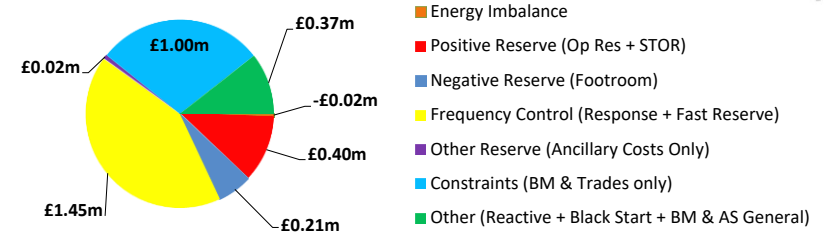

SBP/SSP Vs NIV 16-Jul-2025

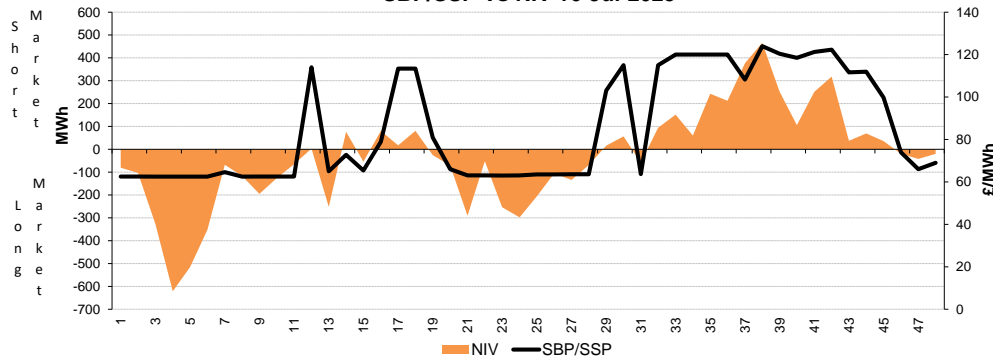

Commentary

The market alternated between long and short throughout the day. Trades were required for Margin. Trades and BM Actions helped to manage thermal constraints in England throughout the day. Trades and BM Actions also supported Voltage Control.

Public