

Date:

Thursday 03 Jul 2025

BSUoS Final Tariff: £10.74/MWh



Total Outturn: £9.45m

Daily Balancing Costs





BM Cost (Indicative)


AS Cost (Estimate)

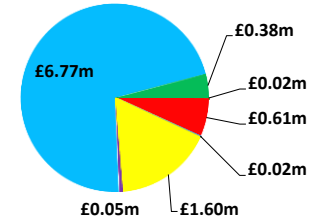

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

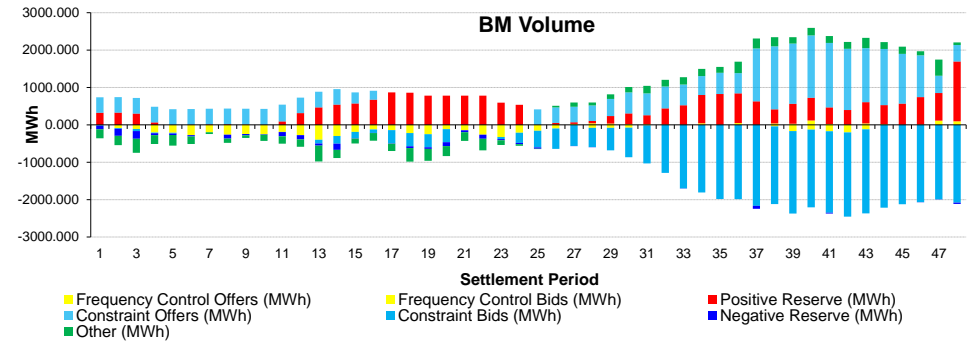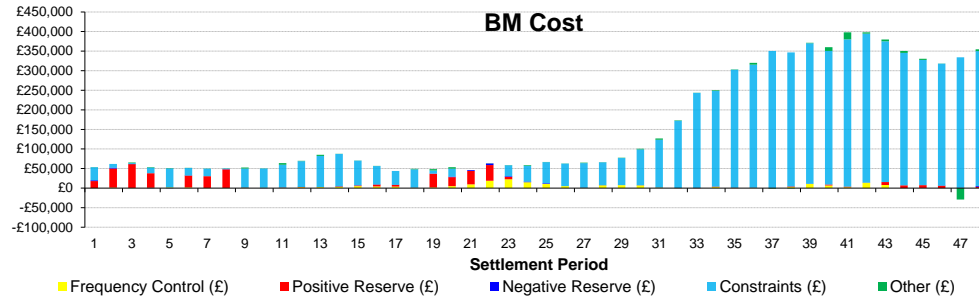

SBP/SSP Vs NIV 03-Jul-2025

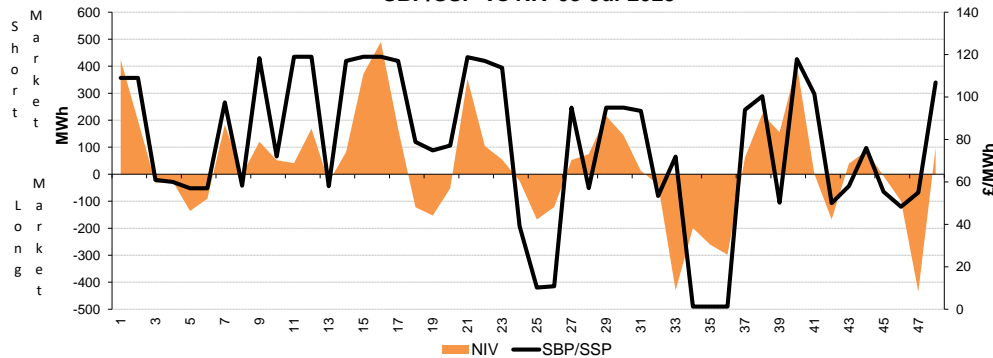

Commentary

The market alternated frequently between long and short throughout the day. Trades and BM Actions helped to manage thermal constraints in England and Scotland. Trades and BM Actions also supported Voltage Control and further BM Actions supported System Inertia.

Public