

Date:

Friday 15 Aug 2025

BSUoS Final Tariff: £10.74/MWh

Total Outturn: £3.50m

Daily Balancing Costs







BM Cost (Indicative)

AS Cost (Estimate)

£1.95m

£1.55m

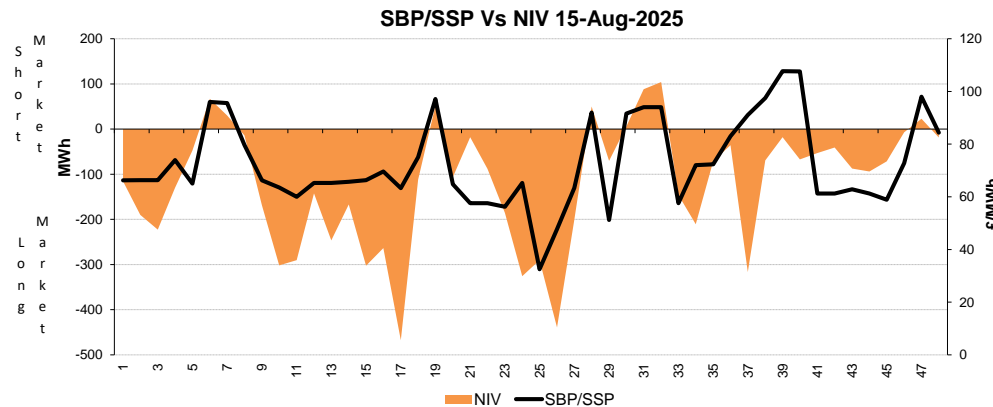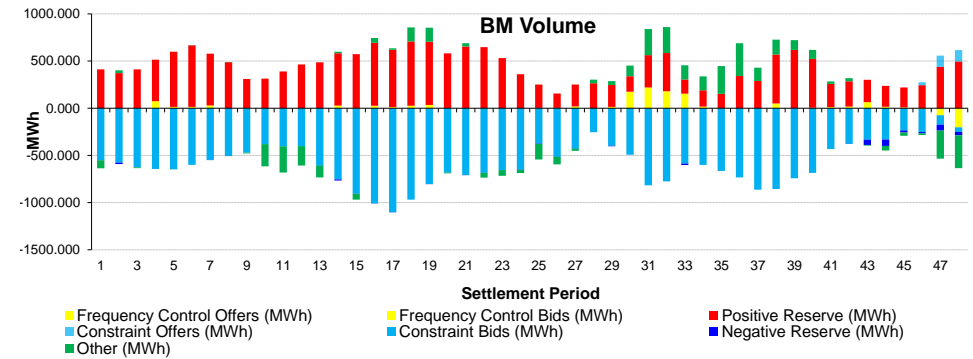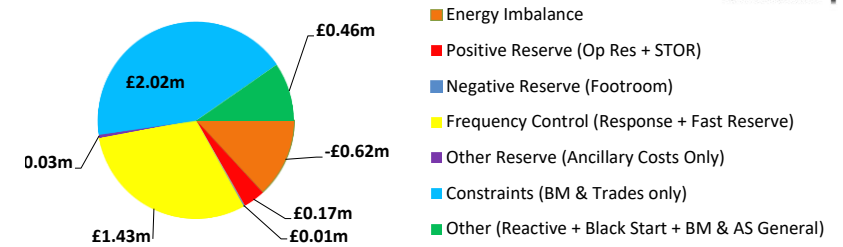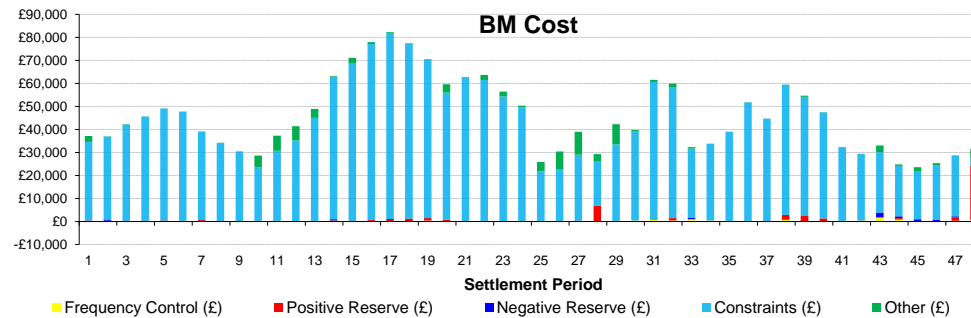

Commentary

The market was predominantly long throughout the day and short for few brief periods. Trades were required for Margin. Trades and BM Actions helped to manage thermal constraints in Southern England and Scotland. BM Actions also supported Voltage Control.

Public