

Date:

Tuesday 26 Aug 2025

BSUoS Final Tariff: £10.74/MWh






Total Outturn: £6.89m

Daily Balancing Costs



BM Cost (Indicative)

AS Cost (Estimate)

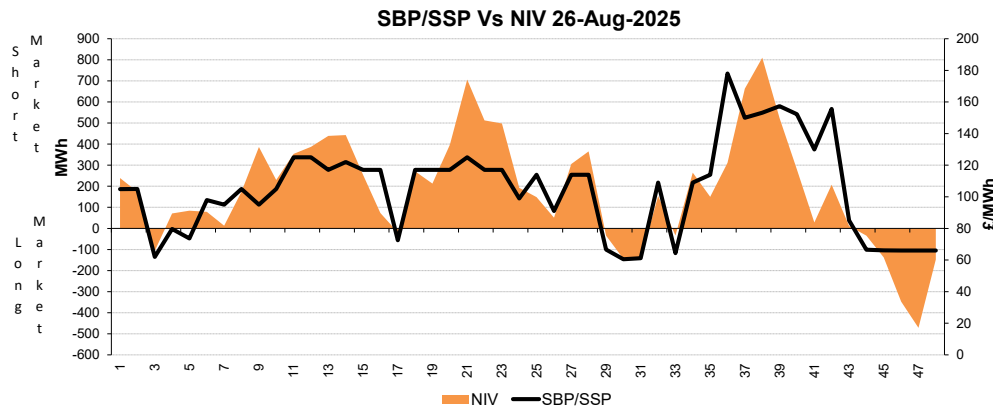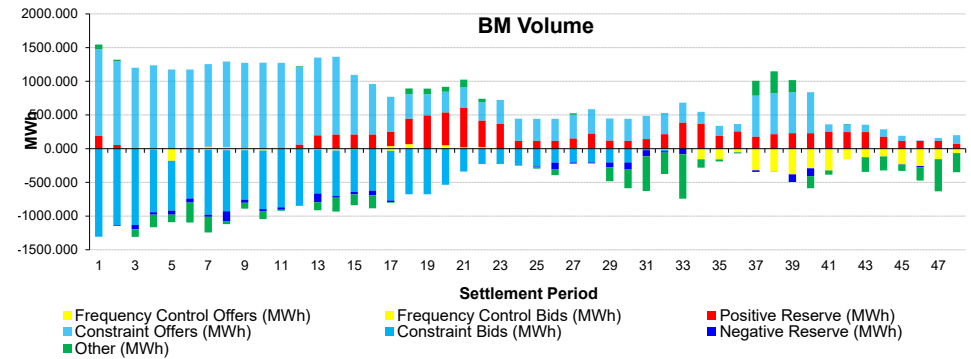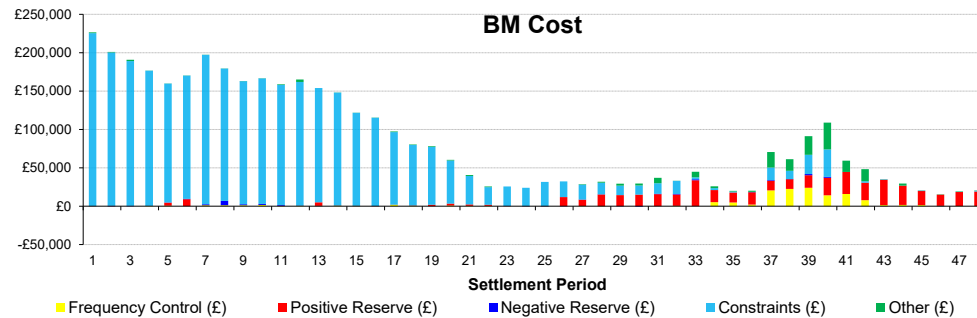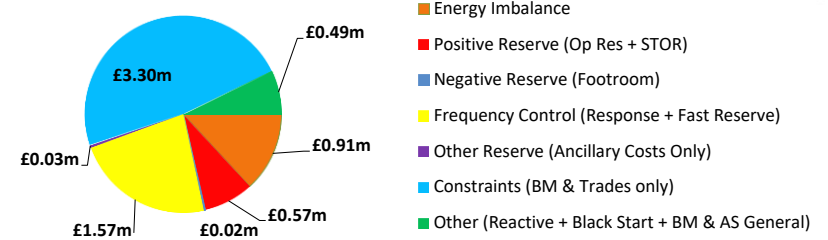

Commentary

The market was short throughout most of the day. Trades were required for Margin. Trades and BM Actions helped to manage thermal constraints in the south of England during the daytime. BM Actions were also required to manage thermal constraints in Scotland during the first half of the day. Trades and BM Actions supported Voltage Control and further BM Actions supported System Inertia.

Public