

Date:

Saturday 02 Aug 2025

BSUoS Final Tariff: £10.74/MWh

Total Outturn: £5.81m

Daily Balancing Costs







BM Cost (Indicative)

AS Cost (Estimate)

£2.14m

£3.67m

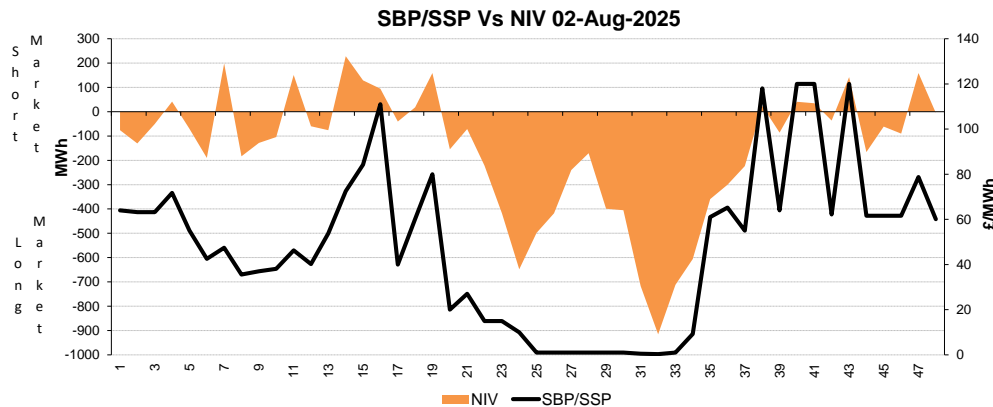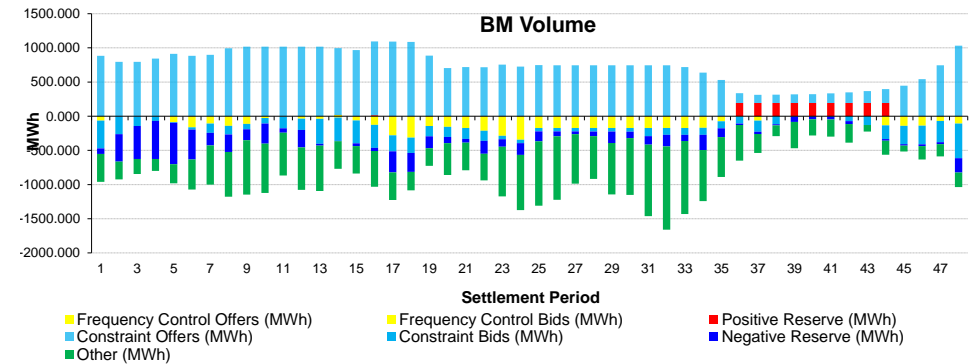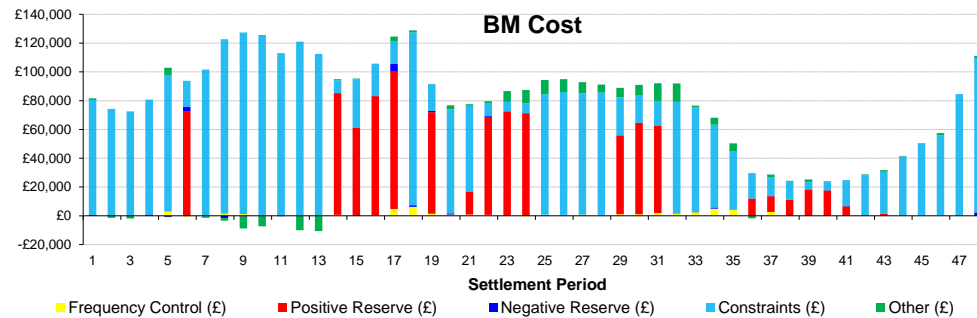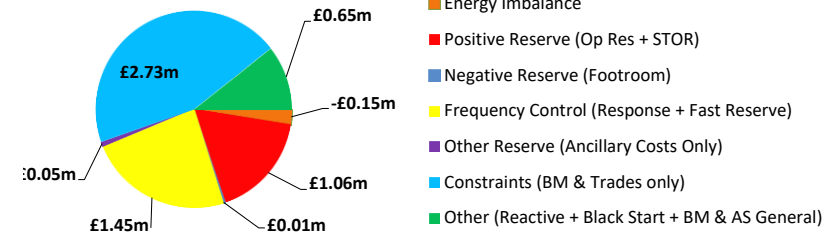

Commentary

The market was long throughout the daytime between 09:30 and 18:30, and alternated between long and short either side of this. Trades were required for Downward Regulation. Trades helped to manage thermal constraints in the South of England throughout most of the day. BM Actions also helped to manage thermal constraints in England and Scotland at various points throughout the day. Further BM Actions supported Voltage Control and System Inertia.

Public