






Date:

Sunday 17 Aug 2025

BSUoS Final Tariff: £10.74/MWh

Total Outturn: £4.57m

Daily Balancing Costs

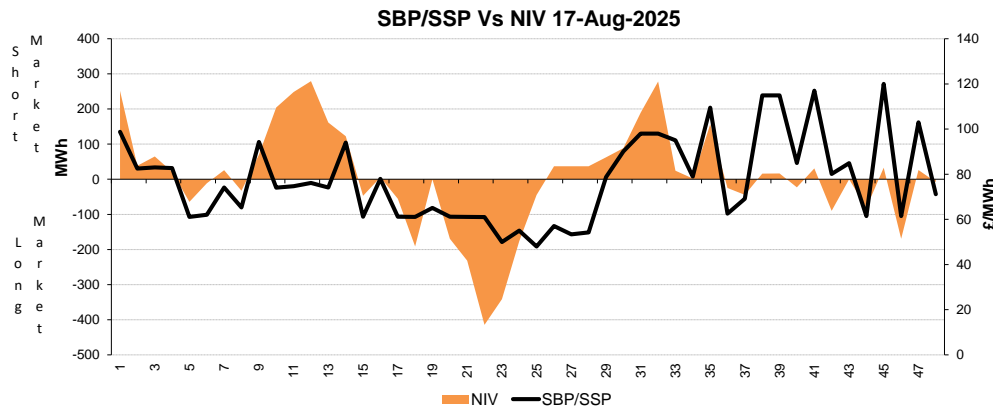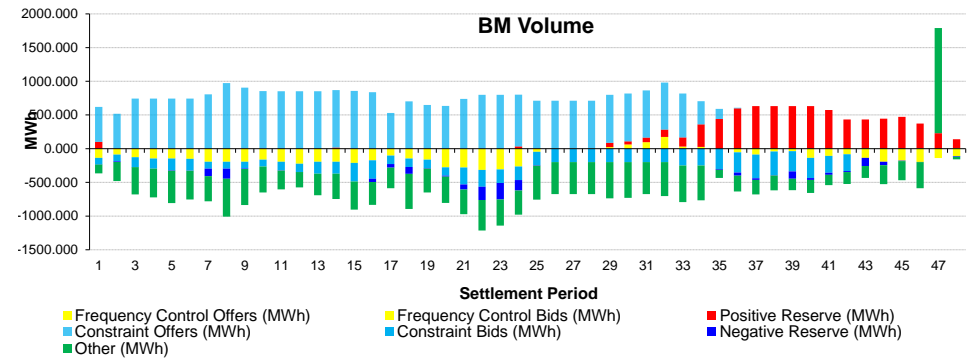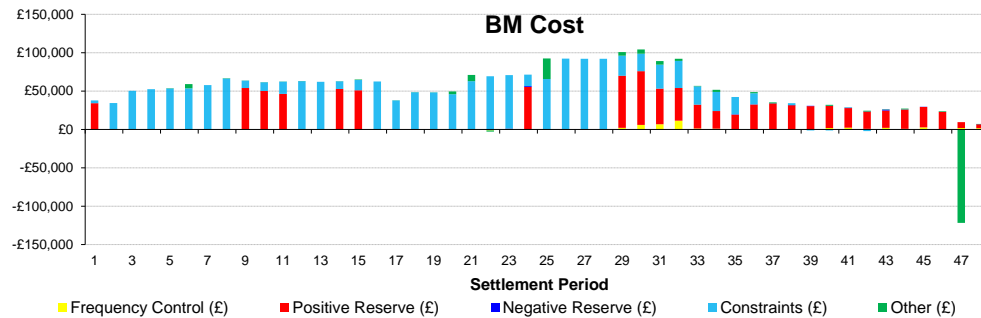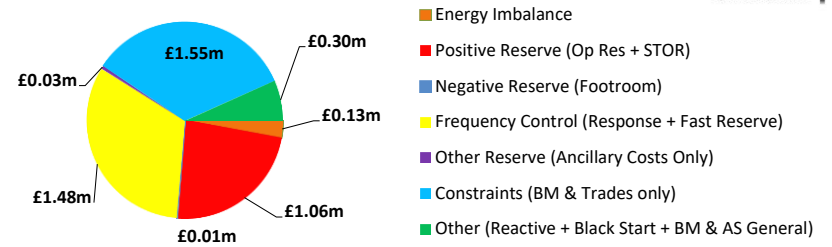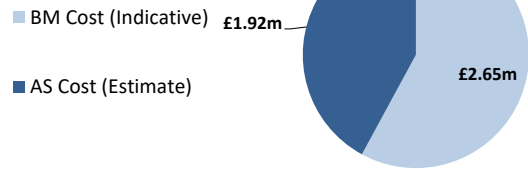

Commentary

The market alternated between long and short throughout the day. Trades were required for Downward Regulation. Trades were required to manage thermal constraints in South of England throughout the day. Trades and BM Actions also supported Voltage Control. Further BM Actions supported System Inertia.

Public