

Date: Thursday 11 Sep 2025

BSUoS Final Tariff: £10.74/MWh





Total Outturn: £14.21m

Daily Balancing Costs




BM Cost (Indicative)

AS Cost (Estimate)

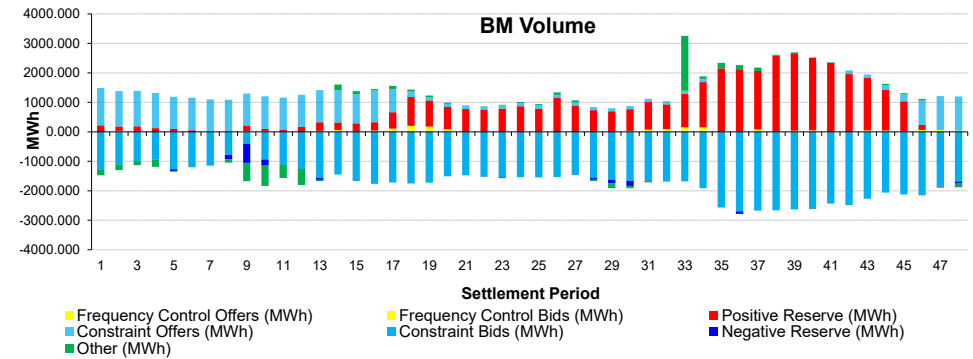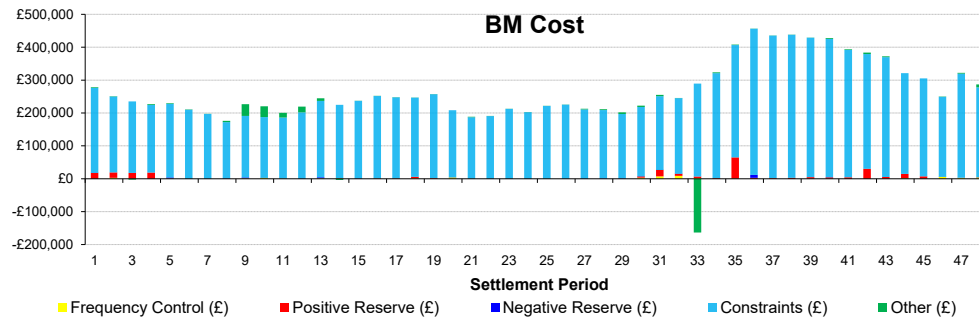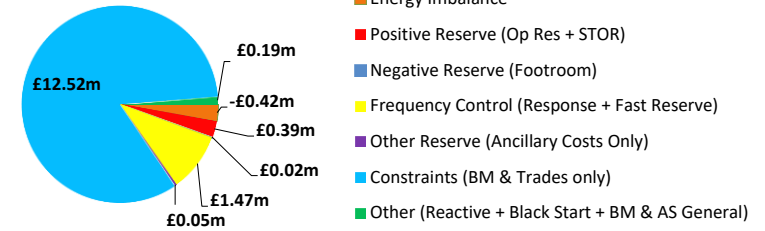

SBP/SSP Vs NIV 11-Sep-2025

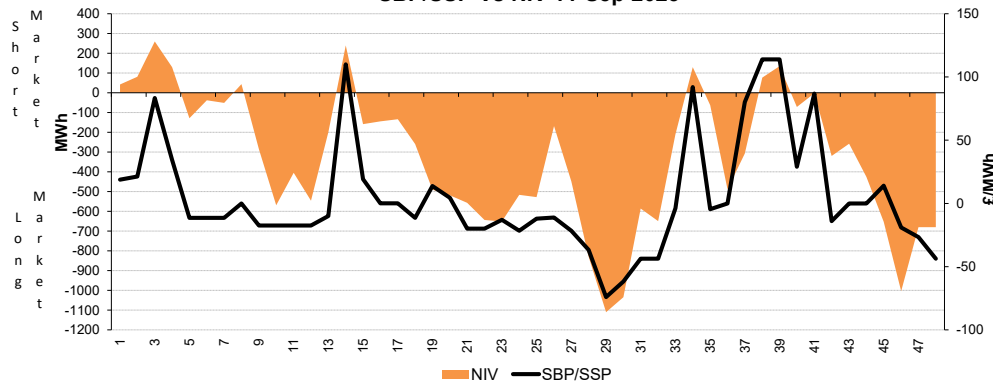

Commentary

The market was long throughout most of the day. Trades were required for Downward Regulation. BM Actions were required to manage thermal constraints in Scotland throughout the day. Trades and BM Actions also helped to manage thermal constraints in Southern England during the evening. Trades and BM Actions further supported Voltage Control and BM Actions also supported System Inertia.

Public