

Date:

Saturday 13 Sep 2025

BSUoS Final Tariff: £10.74/MWh






Total Outturn: £9.37m

Daily Balancing Costs



BM Cost (Indicative)

AS Cost (Estimate)

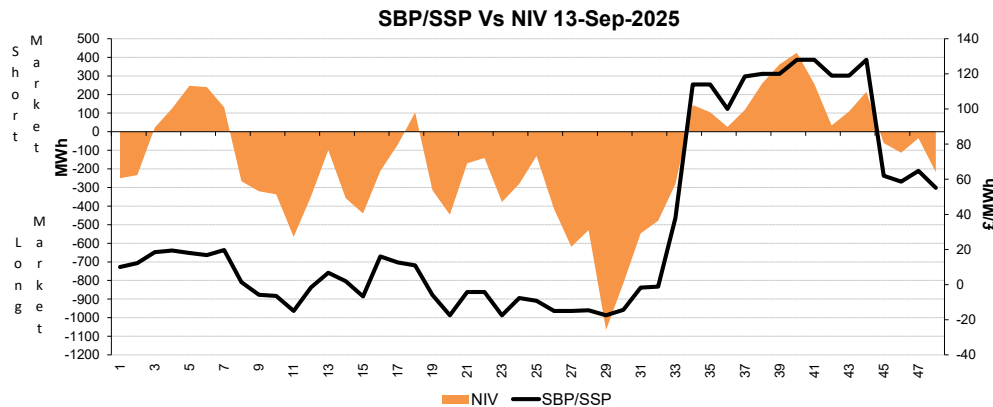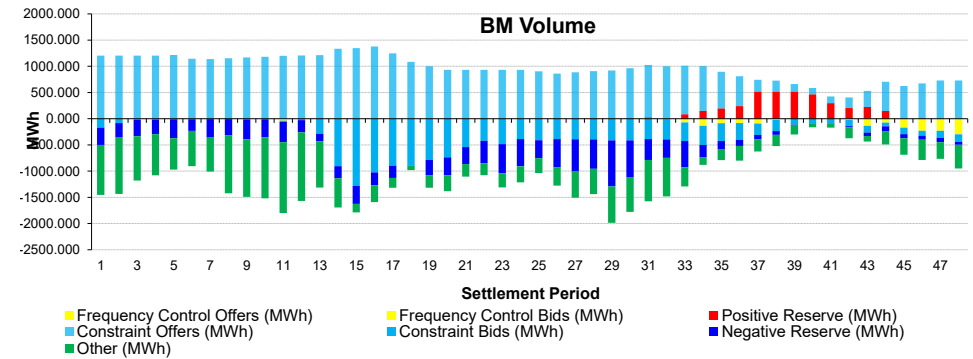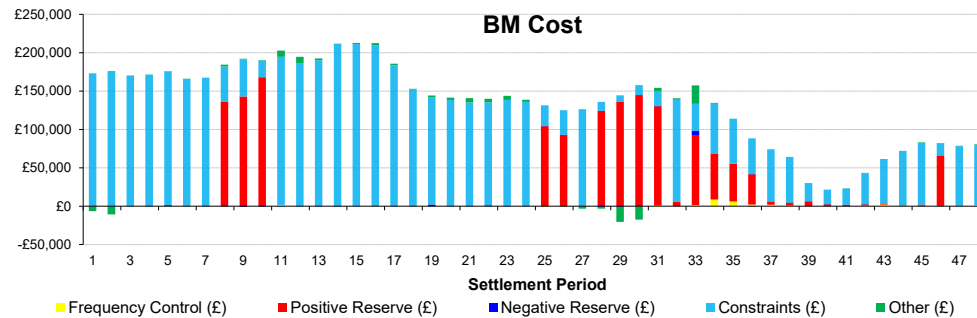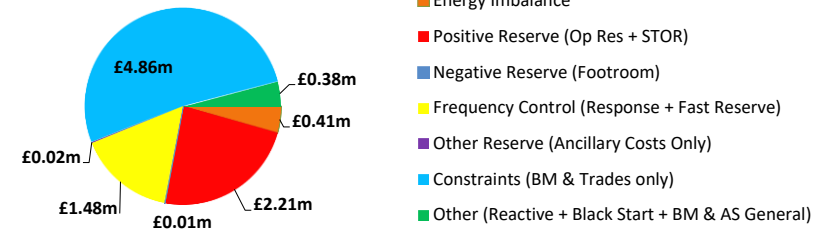

Commentary

The market was mostly long until 16:30, and then was mostly short during the evening. Trades were required for Downward Regulation. Trades and BM Actions were required to manage thermal constraints in Southern England throughout the day, with further BM Actions also taken at points throughout the day to manage thermal constraints in Scotland. Trades and BM Actions supported Voltage Control. BM Actions also supported System Inertia.

Public