

Date:

Monday 15 Sep 2025

BSUoS Final Tariff: £10.74/MWh



Total Outturn: £13.80m

Daily Balancing Costs






BM Cost (Indicative)

AS Cost (Estimate)

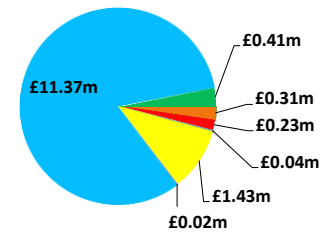

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

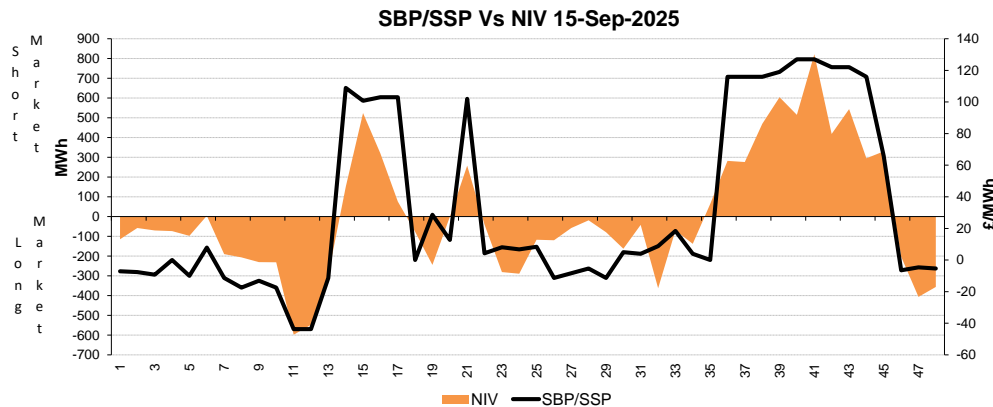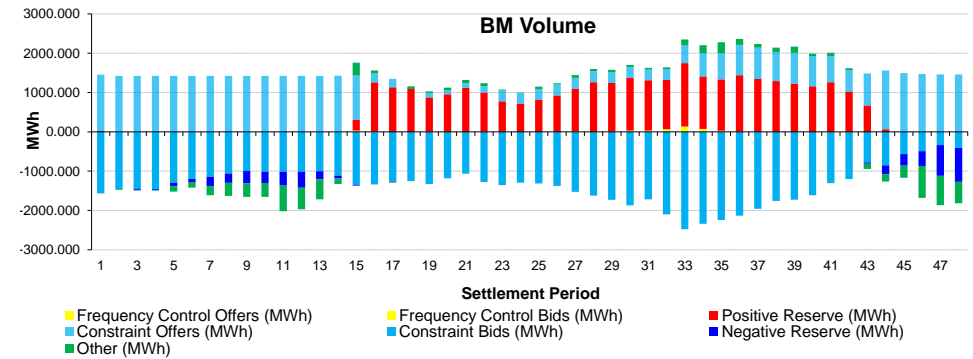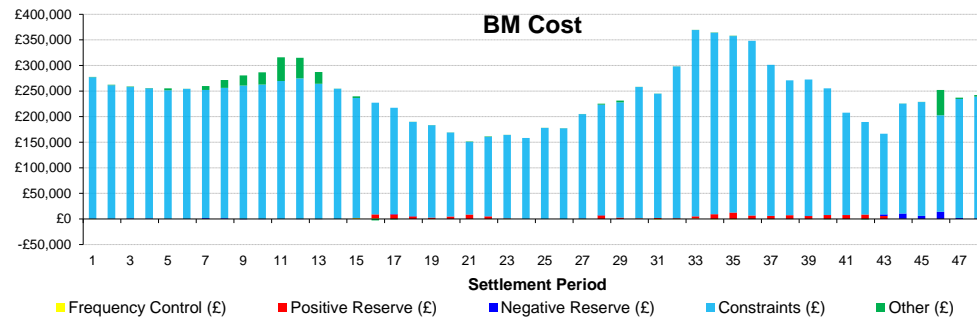

Commentary

The market alternated between long and short throughout the day. Trades were required for Downward Regulation. Trades and BM Actions helped to manage thermal constraints in Scotland and England throughout the day. Trades and BM actions also supported Voltage Control and further BM Actions supported System Inertia.

Public