

Date:

Sunday 21 Sep 2025

BSUoS Final Tariff: £10.74/MWh






Total Outturn: £13.72m

# Daily Balancing Costs



BM Cost (Indicative)

AS Cost (Estimate)

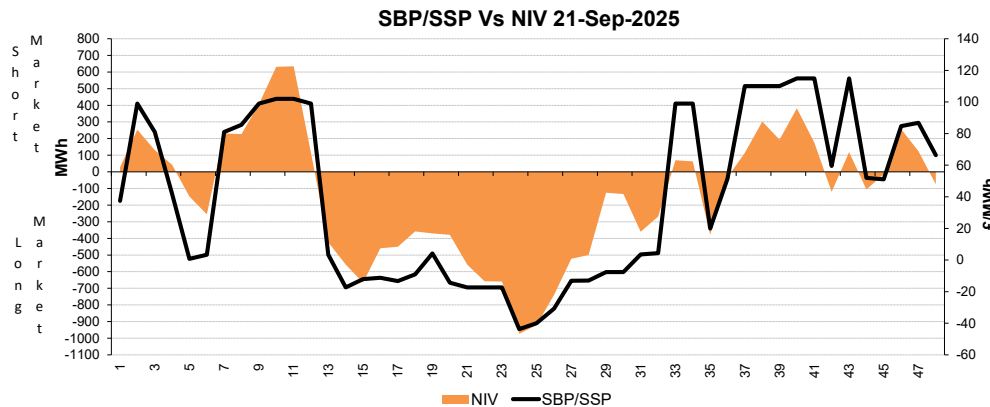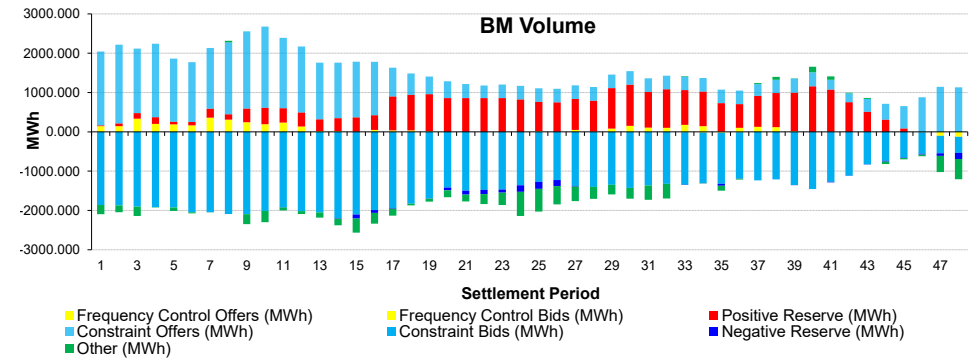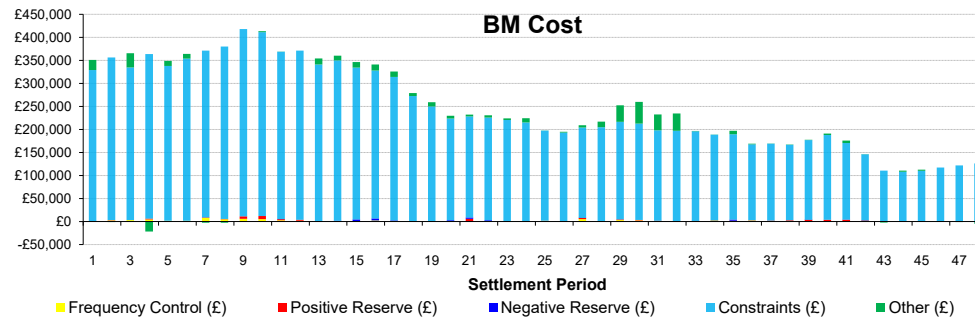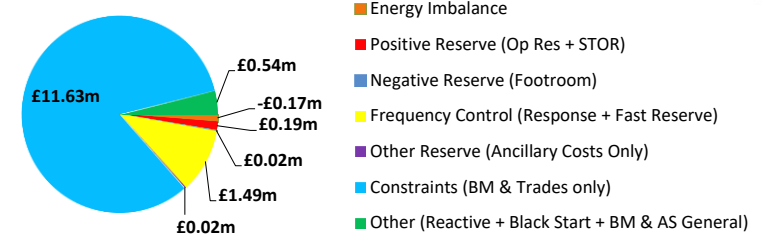

## Commentary

The market was long during the daytime, from 06:00-16:00, and alternated between long and short either side of this. Trades were required for Downward Regulation. BM Actions were required throughout the day to manage thermal constraints in England and Scotland. Further BM Actions were also required to support Voltage Control and System Inertia.

Public