

Date: Thursday 09 Oct 2025

BSUoS Final Tariff: £15.69/MWh



Total Outturn: £19.77m

Daily Balancing Costs



BM Cost (Indicative)

AS Cost (Estimate)

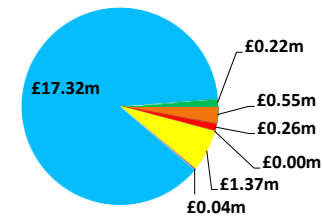

Energy Imbalance

Positive Reserve (Op Res + STOR)



Negative Reserve (Footroom)

Frequency Control (Response + Fast Reserve)


Other Reserve (Ancillary Costs Only)

Constraints (BM & Trades only)

Other (Reactive + Black Start + BM & AS General)

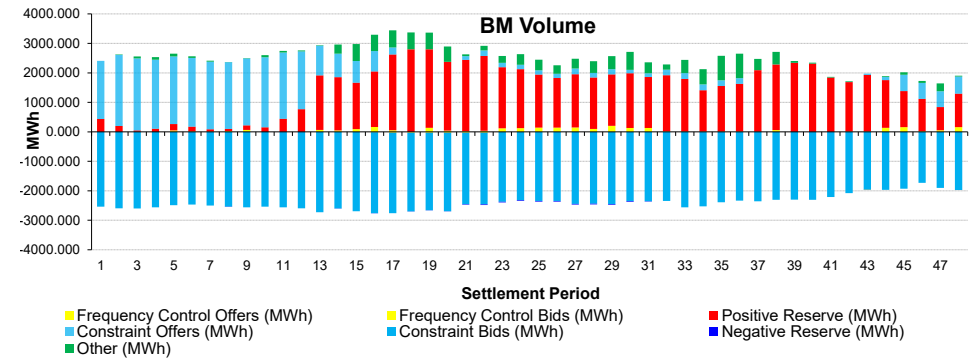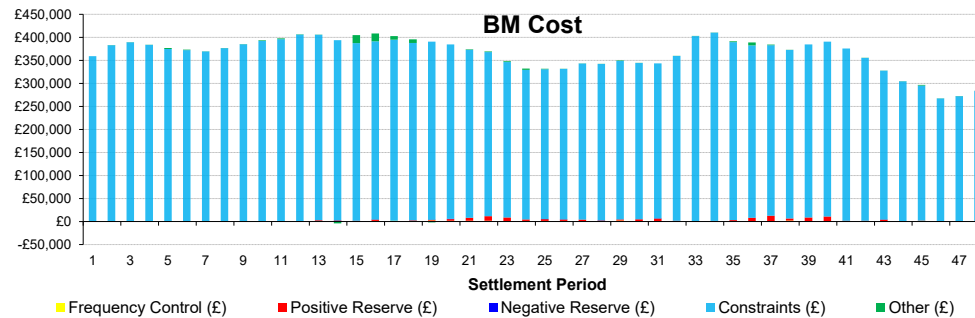

SBP/SSP Vs NIV 09-Oct-2025

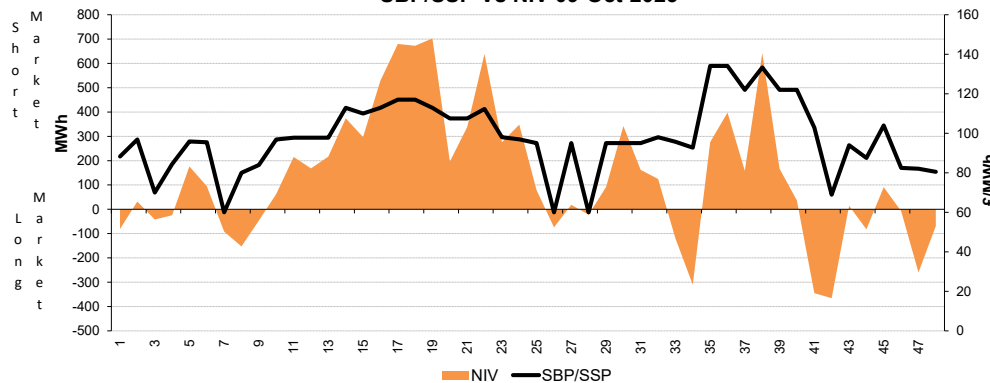

Commentary

The market had a sustained long period in the morning between 04:30-12:30, and alternated between long and short either side of this. Trades were required for Margin. BM Actions were required to manage thermal constraints in Scotland throughout the day. Further BM Actions supported Voltage Control.

Public