

Date:

Friday 10 Oct 2025

BSUoS Final Tariff: £15.69/MWh



Total Outturn: £13.09m

# Daily Balancing Costs



BM Cost (Indicative)

AS Cost (Estimate)

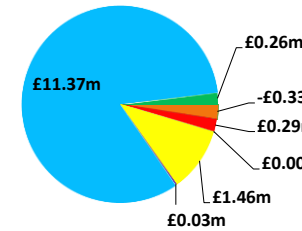

Energy Imbalance

Positive Reserve (Op Res + STOR)



Negative Reserve (Footroom)

Frequency Control (Response + Fast Reserve)


Other Reserve (Ancillary Costs Only)

Constraints (BM & Trades only)

Other (Reactive + Black Start + BM & AS General)

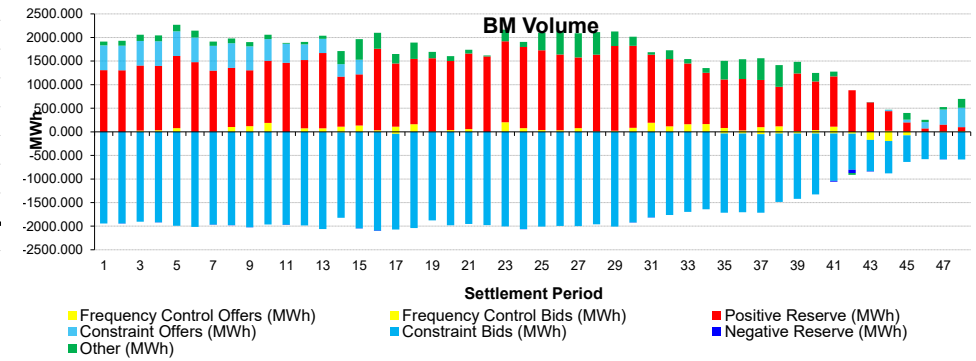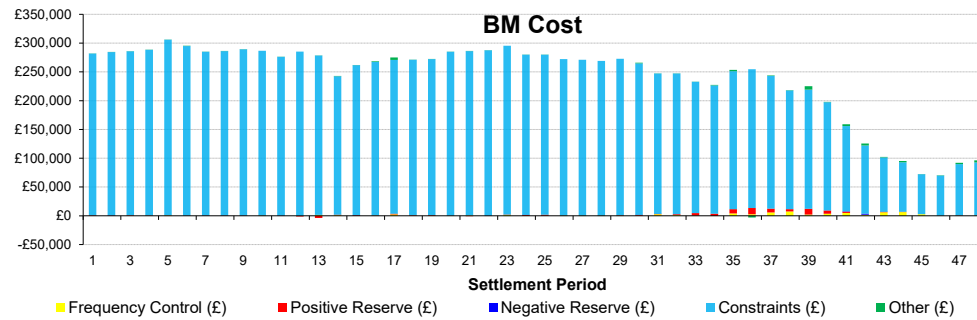

## SBP/SSP Vs NIV 10-Oct-2025

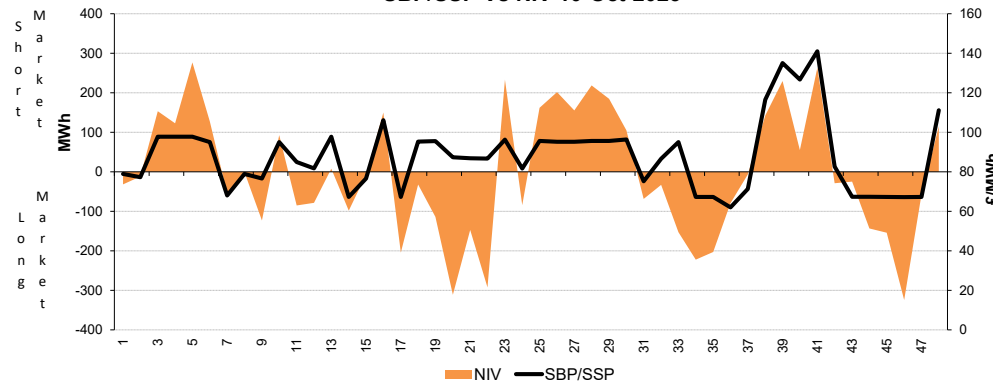

## Commentary

The market alternated between long and short throughout the day. Trades were required for Margin. BM Actions were required to manage thermal constraints in Scotland throughout the day. Further BM Actions supported Voltage Control.

Public