

Date:

Tuesday 28 Oct 2025

BSUoS Final Tariff: £15.69/MWh

Total Outturn: £6.81m

Daily Balancing Costs







BM Cost (Indicative)

AS Cost (Estimate)

£2.24m

£4.57m

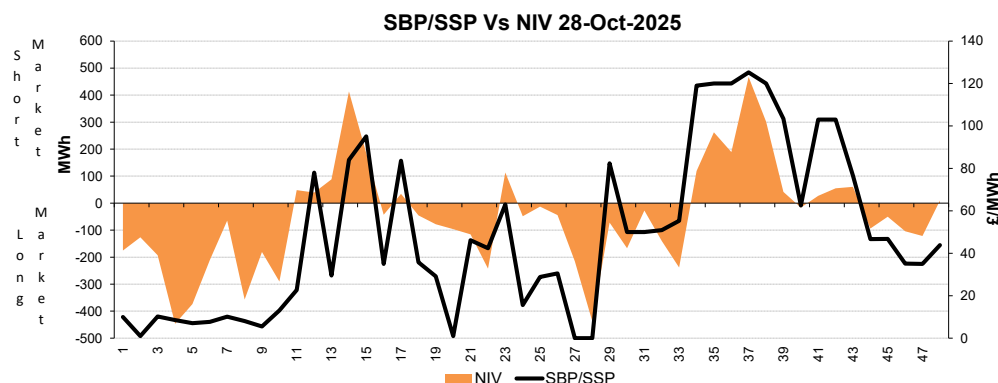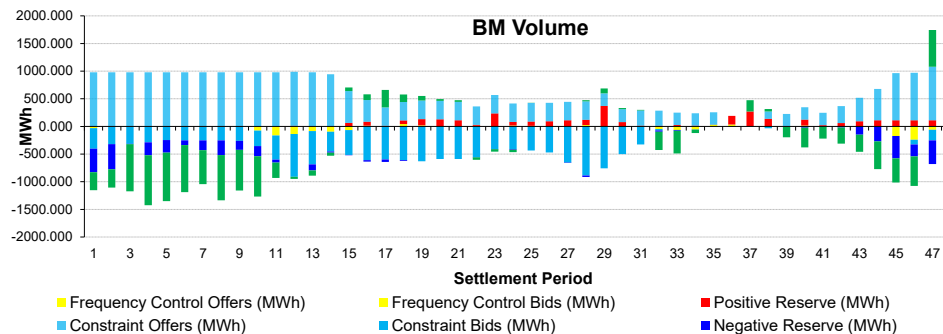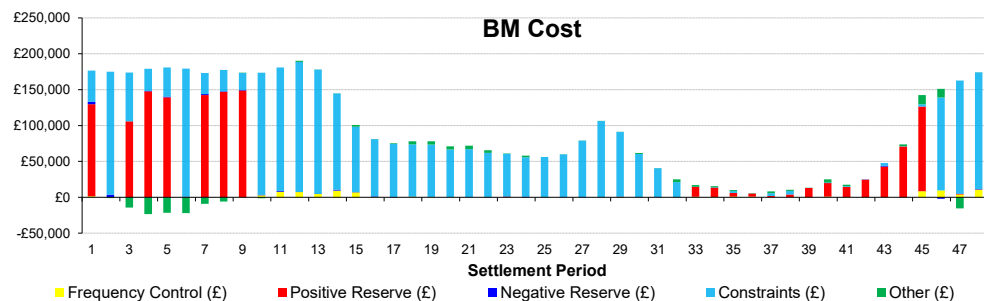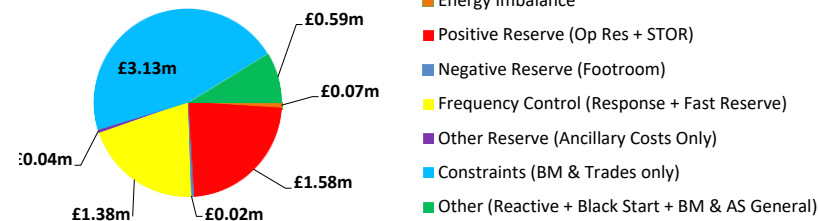

Commentary

The market alternated between long and short throughout the day. Trades were required for Downward Regulation. BM Actions were required to manage thermal constraints, predominantly in Scotland/Northern England throughout the day. Trades and BM Actions supported Voltage Control.

Public