

Date: Wednesday 22 Oct 2025






BSUoS Final Tariff: £15.69/MWh
Total Outturn: £11.71m

Daily Balancing Costs



BM Cost (Indicative)

AS Cost (Estimate)

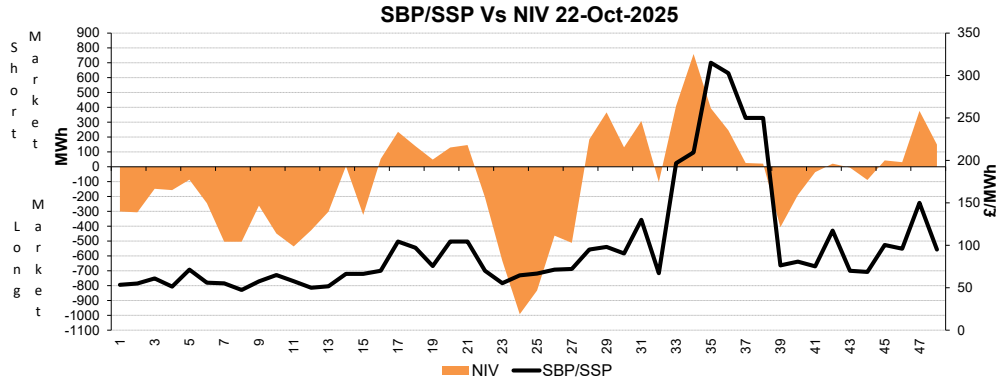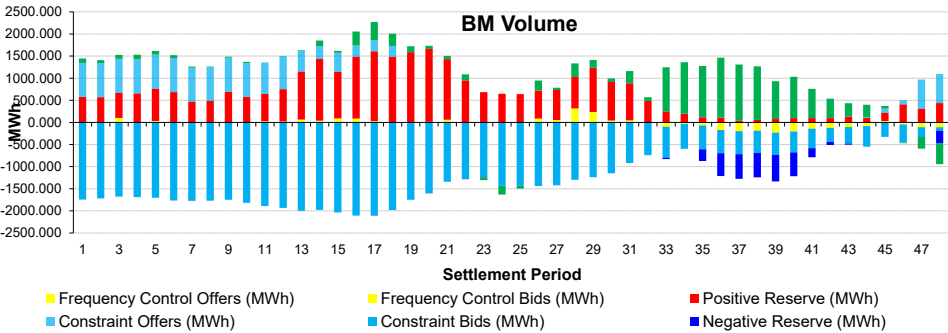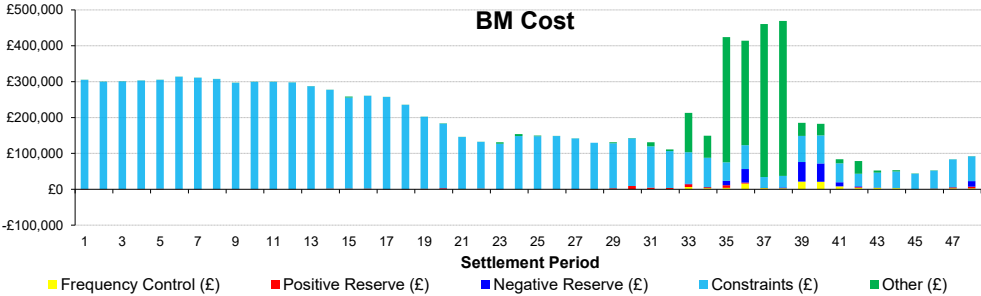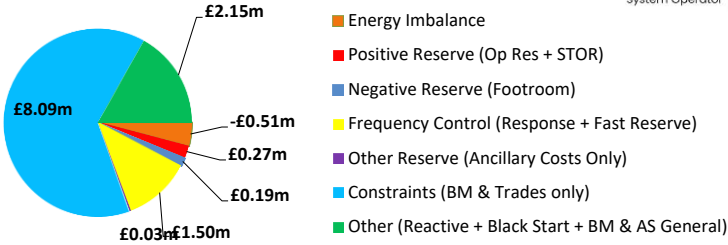

Commentary
The market alternated between long and short throughout the day. Trades were required for Margin. Trades and BM Actions were required to manage thermal constraints in Scotland and England, throughout the whole day. Trades and BM Actions supported Voltage Control and further BM Actions supported System Inertia.