

Date: Wednesday 26 Nov 2025



BSUoS Final Tariff: £15.69/MWh  
Total Outturn: £11.53m

# Daily Balancing Costs





BM Cost (Indicative)


AS Cost (Estimate)

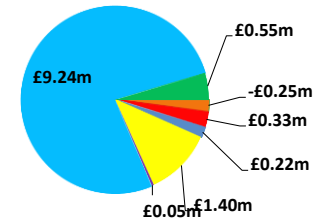

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

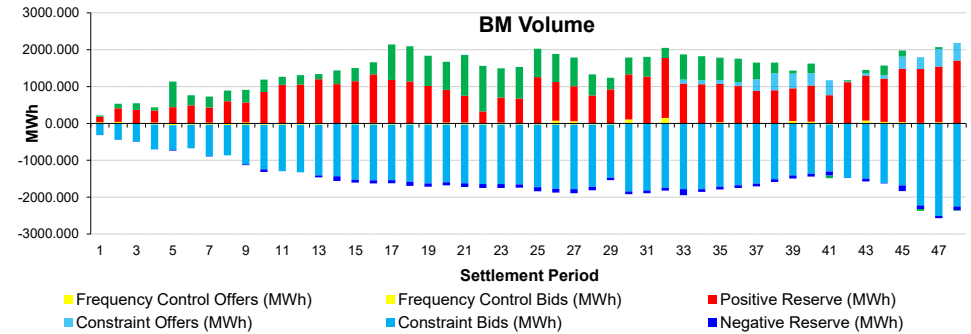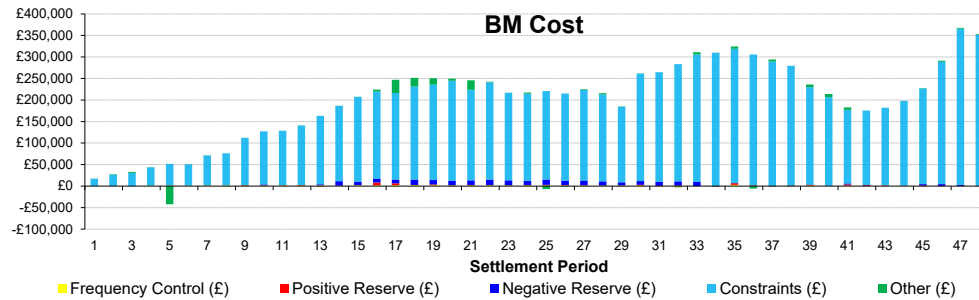

## SBP/SSP Vs NIV 26-Nov-2025

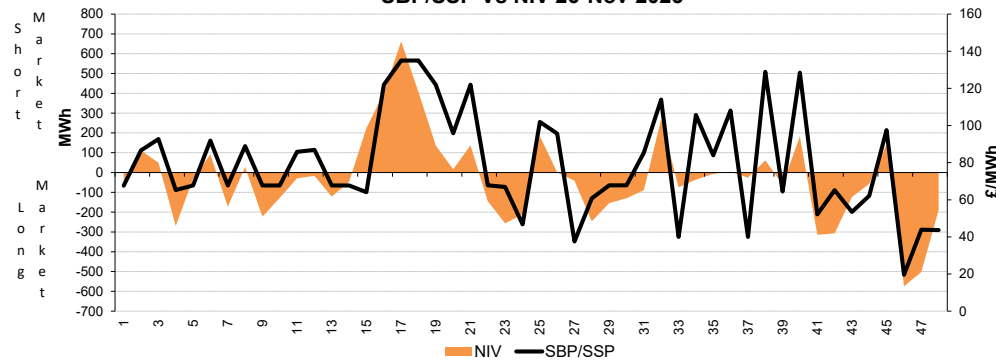

## Commentary

The market alternated between long and short throughout the day. Trades were required for Margin. BM Actions were required to manage thermal constraints in Scotland and England. Trades and BM Actions were also required for Voltage Control.

Public