

Date: Thursday 27 Nov 2025

BSUoS Final Tariff: £15.69/MWh



Total Outturn: £18.45m

Daily Balancing Costs



BM Cost (Indicative)

AS Cost (Estimate)

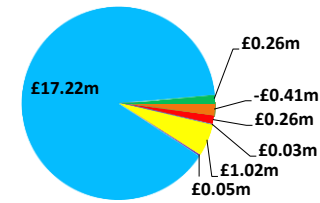

Energy Imbalance

Positive Reserve (Op Res + STOR)



Negative Reserve (Footroom)

Frequency Control (Response + Fast Reserve)


Other Reserve (Ancillary Costs Only)

Constraints (BM & Trades only)

Other (Reactive + Black Start + BM & AS General)

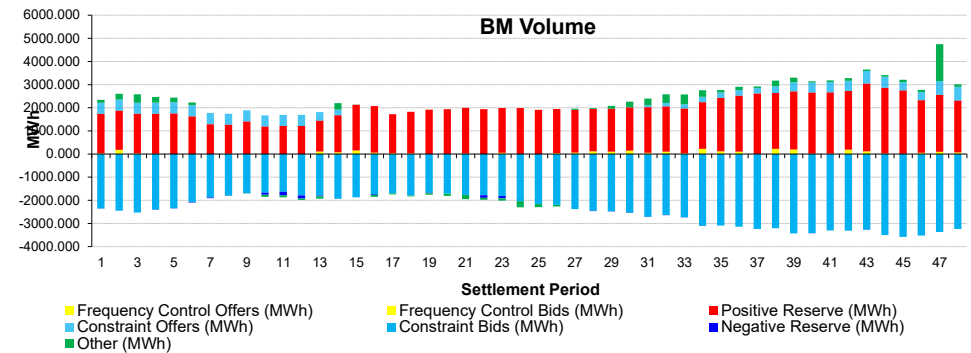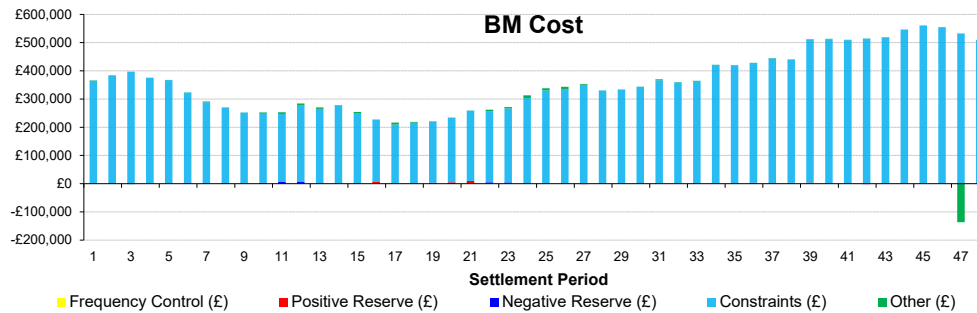

SBP/SSP Vs NIV 27-Nov-2025

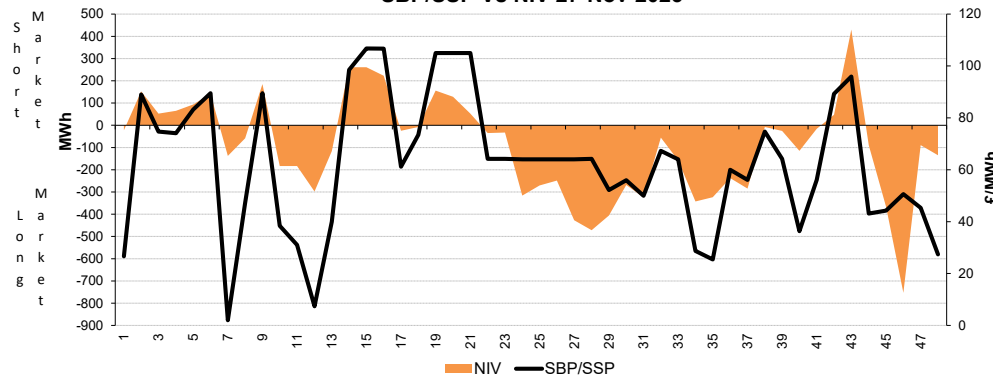

Commentary

The market alternated between long and short throughout the day. No trades were taken for Margin or Downward Regulation. Trades and BM Actions were required to manage thermal constraints in Scotland and Northern England throughout the day. Trades and BM Actions were also required for Voltage Control.

Public