

Date:

Sunday 30 Nov 2025

BSUoS Final Tariff: £15.69/MWh

Total Outturn: £5.27m

Daily Balancing Costs







BM Cost (Indicative)

AS Cost (Estimate)

£1.69m

£3.57m

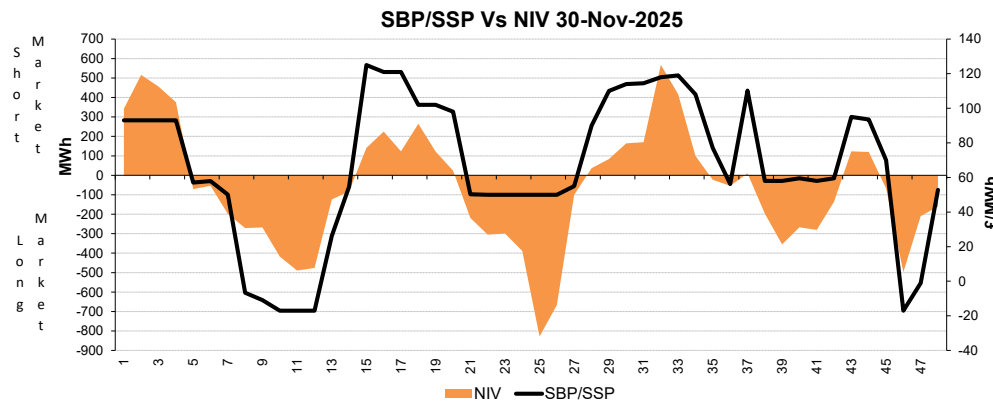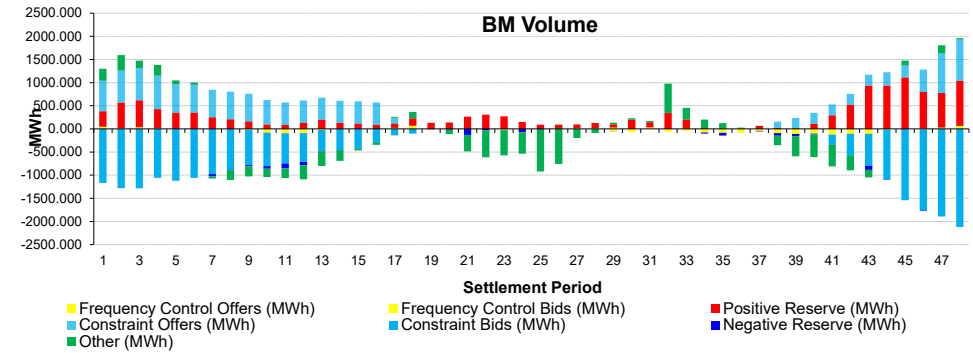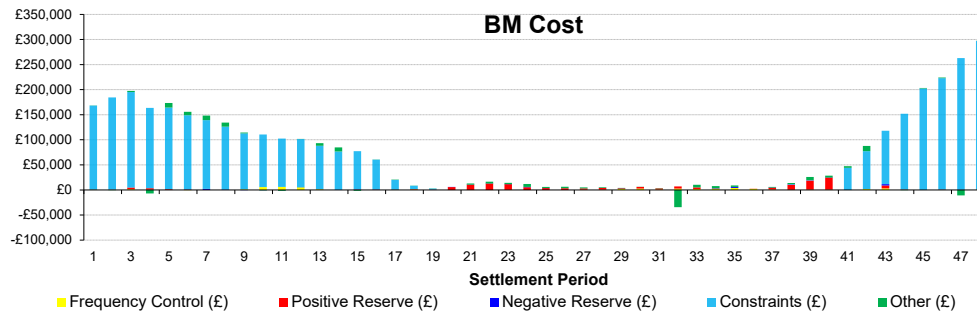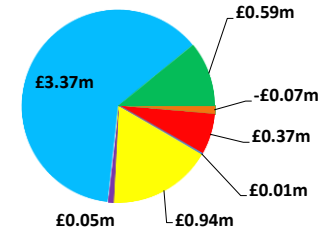

Commentary

The market alternated between long and short throughout the day. Trades were required for Downward Regulation. BM Actions were required to manage thermal constraints in northern England and Scotland in the morning and the evening. Trades and BM Actions supported Voltage Control. Further BM Actions were required to support System Inertia.

Public