
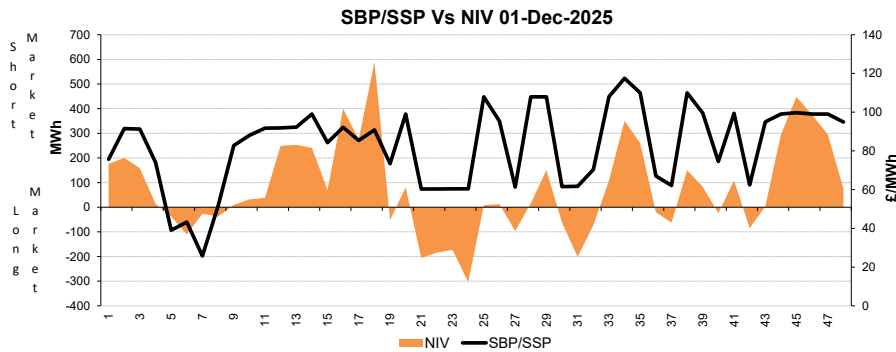
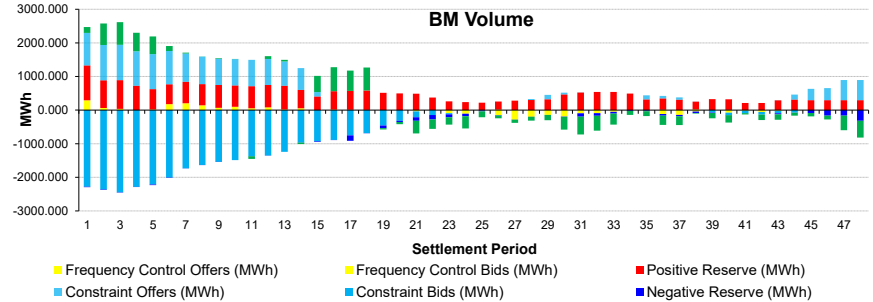
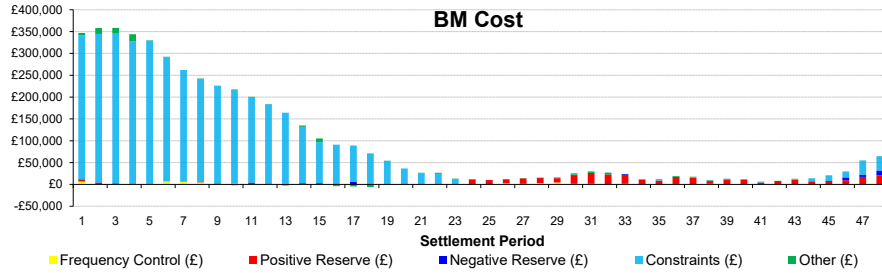
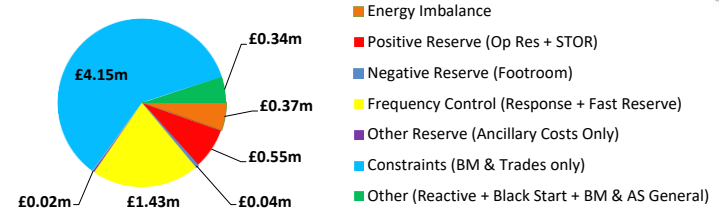


Date:

Monday 01 Dec 2025

BSUoS Final Tariff: £15.69/MWh
Total Outturn: £6.91m

Daily Balancing Costs

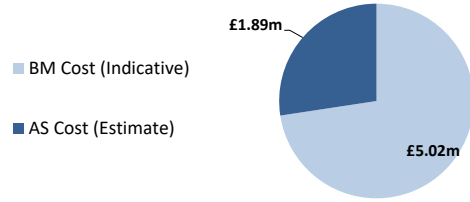

Commentary

The market alternated between long and short throughout the day. Trades were made for Margin and Downward Regulation. BM Actions were required to manage thermal constraints in England and Scotland. Trades and BM Actions supported Voltage Control. Further BM Actions were required for System Inertia.