
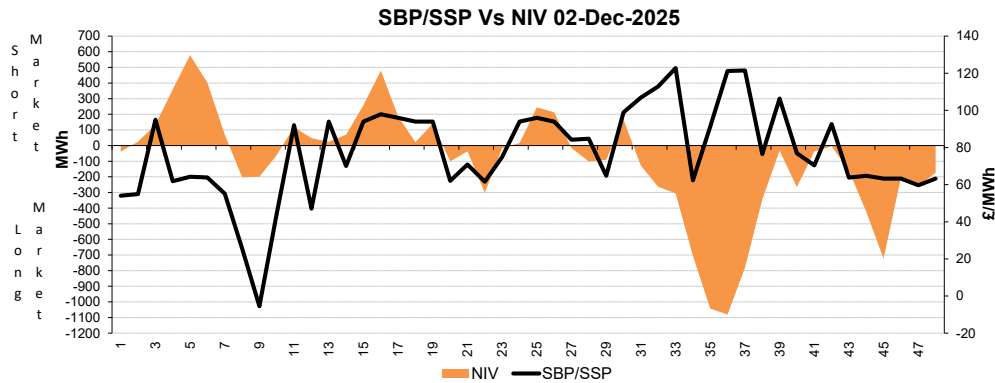
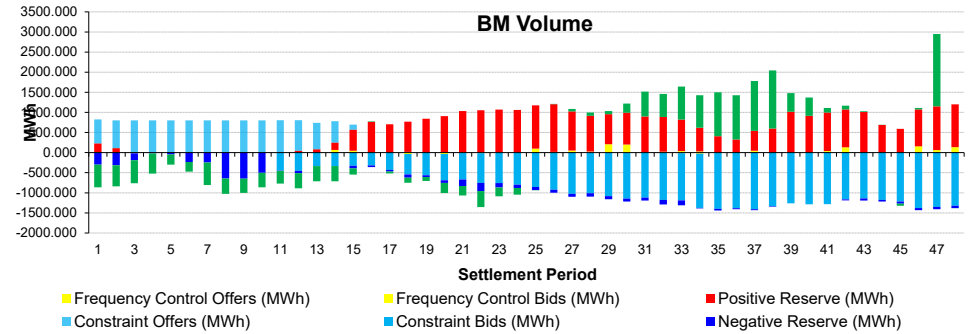
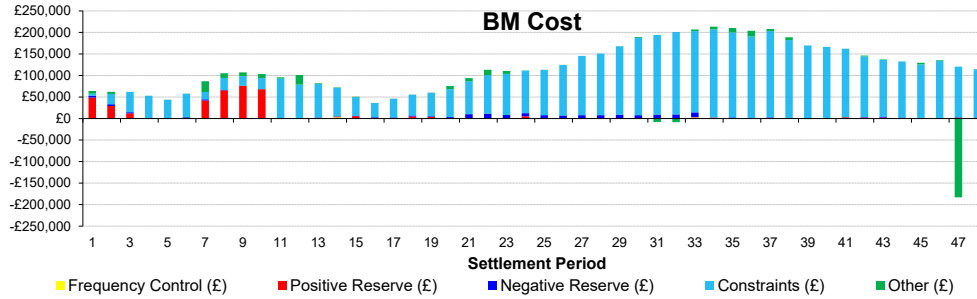
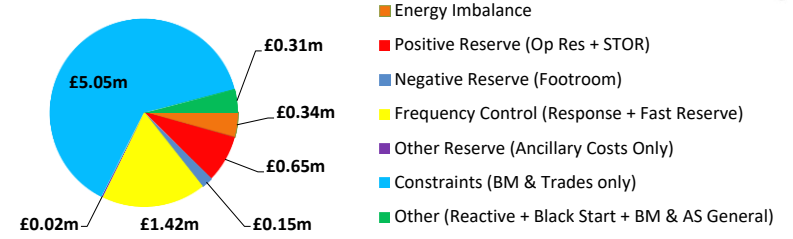


Date: Tuesday 02 Dec 2025

BSUoS Final Tariff: £15.69/MWh  
Total Outturn: £7.93m

# Daily Balancing Costs

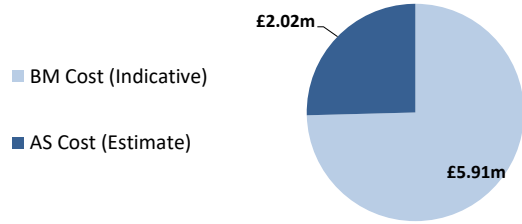

## Commentary

The market alternated between long and short throughout the day. Trades were required for Margin and Downward Regulation.

BM Actions were required to manage thermal constraints in England and Scotland. Trades and BM Actions supported Voltage Control. Further BM Actions were required for System Inertia.