

Date: Wednesday 12 Nov 2025





BSUoS Final Tariff: £15.69/MWh
Total Outturn: £8.10m

Daily Balancing Costs




BM Cost (Indicative)

AS Cost (Estimate)

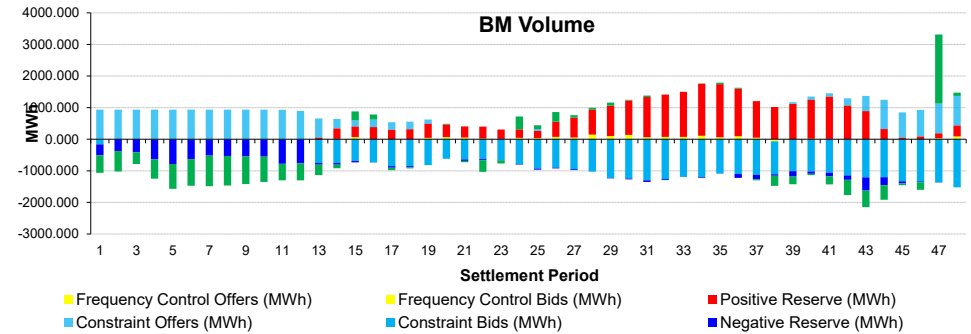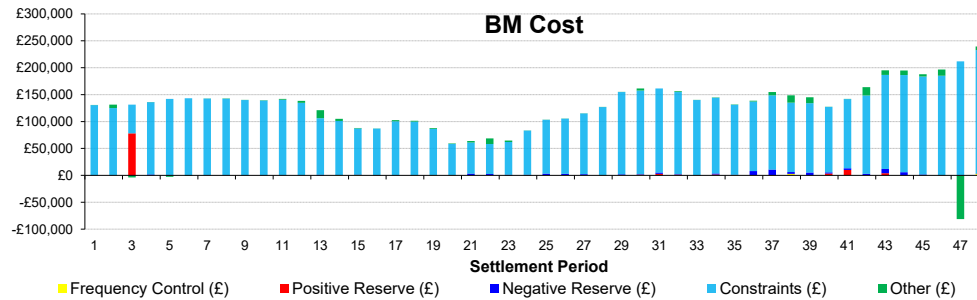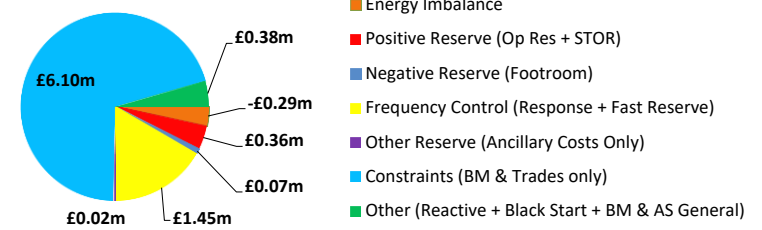

SBP/SSP Vs NIV 12-Nov-2025

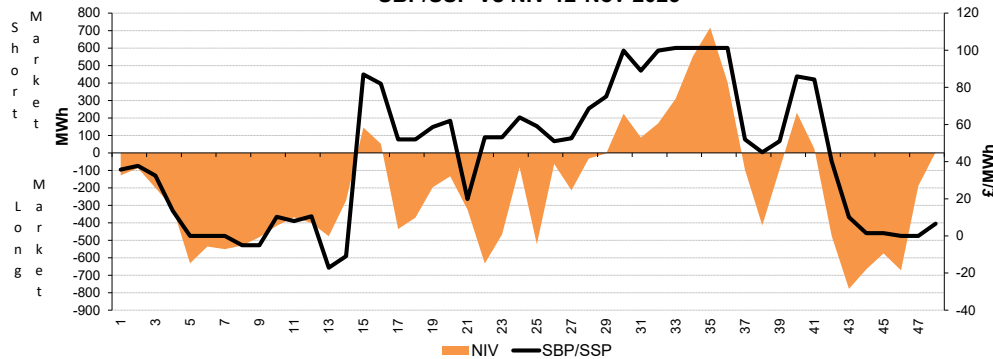

Commentary

The market was predominantly long until a short period between 15:30-18:30, before returning back to being long for most of the evening. Trades were required for Downward Regulation.

Trades and BM Actions were required to manage thermal constraints across England and Scotland throughout the day. Trades and BM Actions also supported Voltage Control. Further BM Actions supported System Inertia.

Public