

Date:

Friday 14 Nov 2025

BSUoS Final Tariff: £15.69/MWh



Total Outturn: £8.52m

Daily Balancing Costs






BM Cost (Indicative)

AS Cost (Estimate)

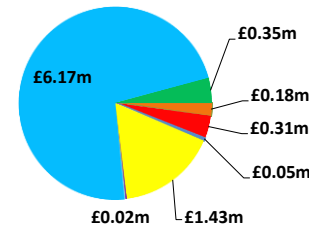

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

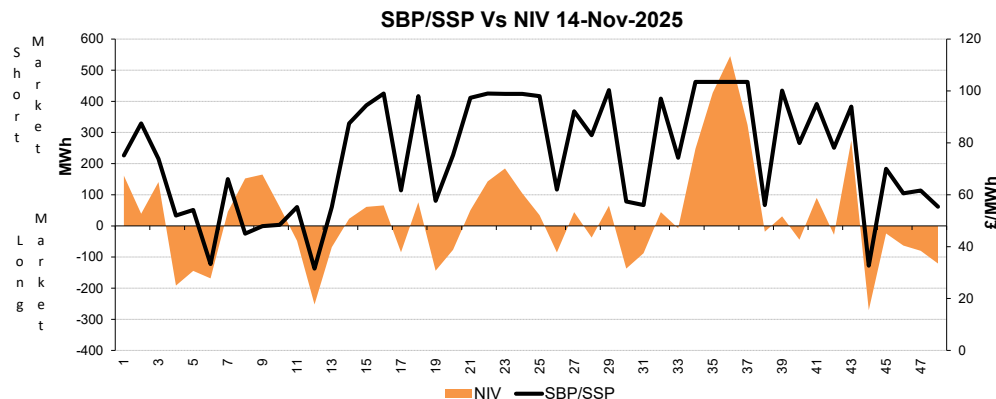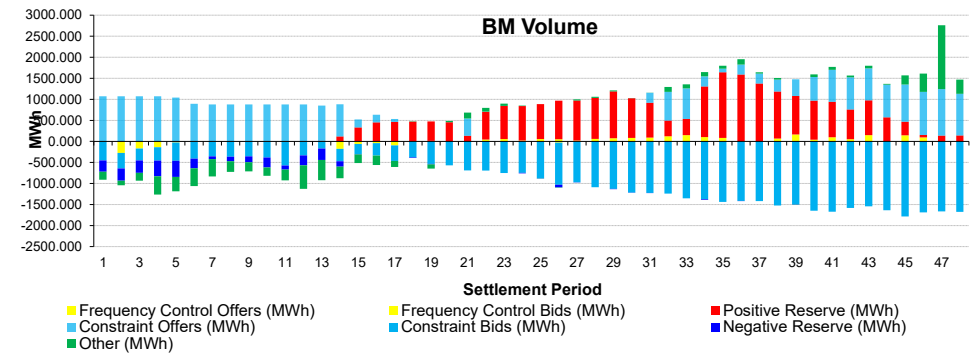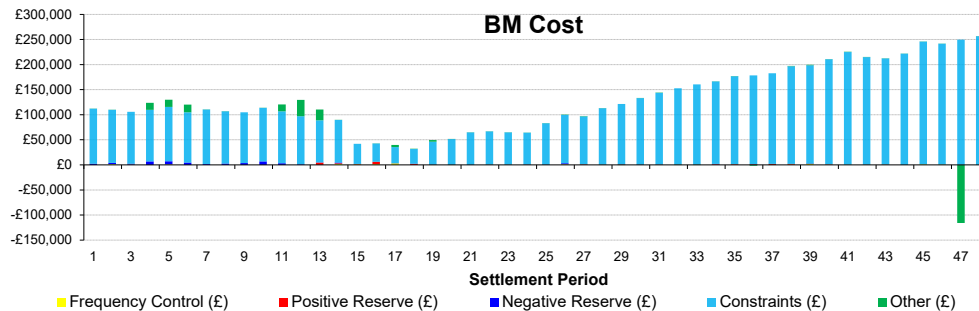

Commentary

The market alternated between long and short throughout the day. No trades were taken for Margin or Downward Regulation. Trades and BM Actions helped to manage thermal constraints in Scotland, northern & southern England from the morning onwards. Trades and BM Actions supported Voltage Control.

Public