



Date: Wednesday 10 Dec 2025

BSUoS Final Tariff: £15.69/MWh
Total Outturn: £17.13m




Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

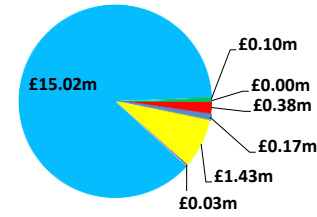

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

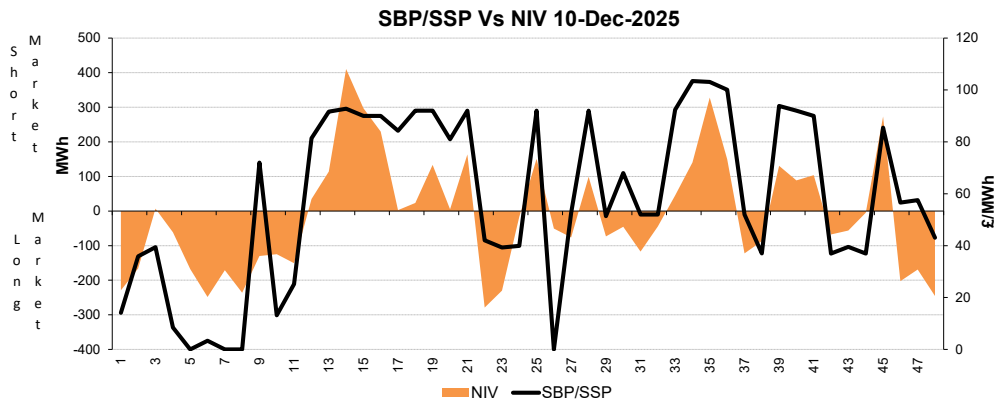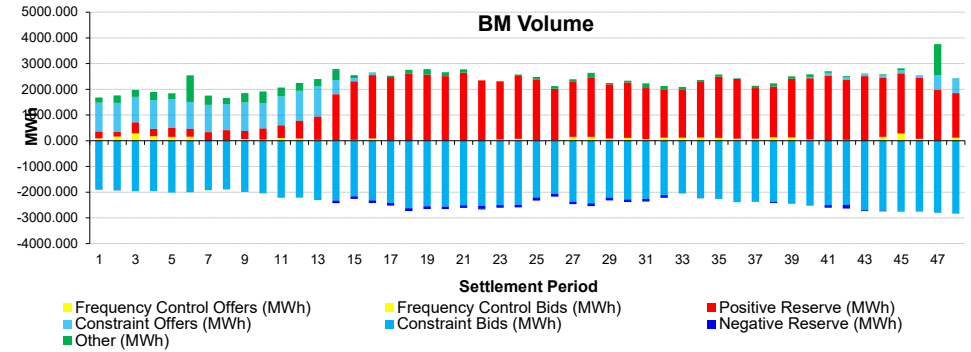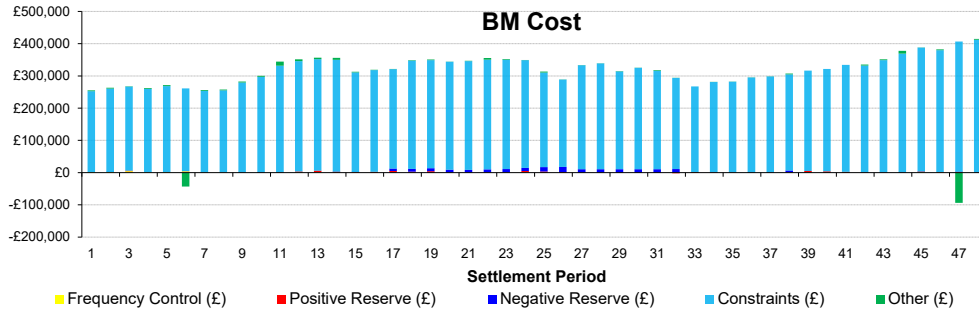

Commentary

The market alternated between long and short throughout the day. No trades were taken for Margin or Downward Regulation. Trades and BM Actions were required to manage thermal constraints throughout the day. Trades and BM Actions also supported Voltage Control. Further BM Actions were required for System Inertia.