

Date:

Monday 08 Dec 2025

BSUoS Final Tariff: £15.69/MWh



Total Outturn: £4.40m

Daily Balancing Costs






BM Cost (Indicative)

AS Cost (Estimate)

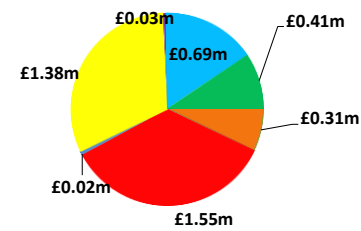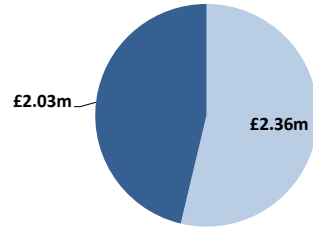

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

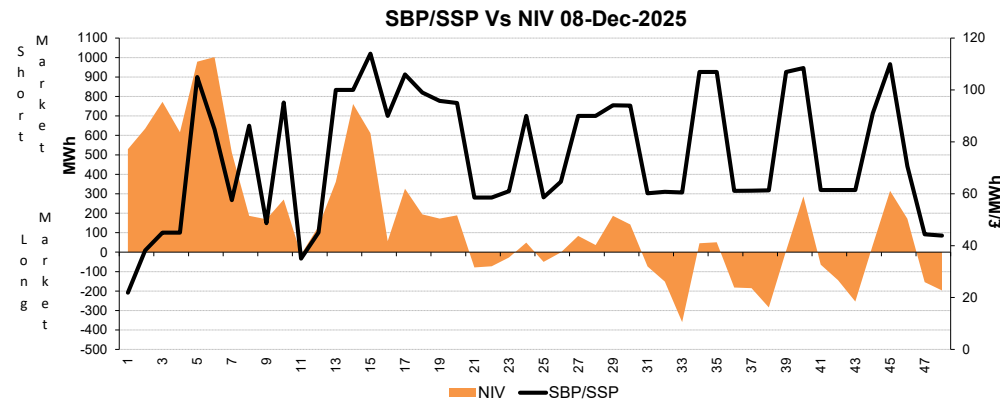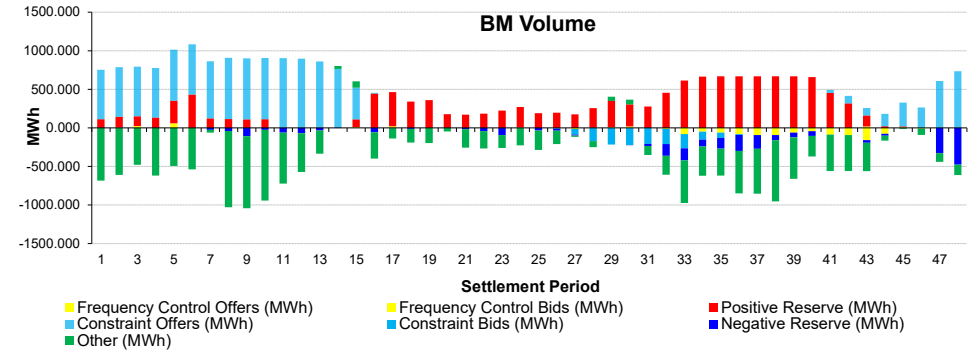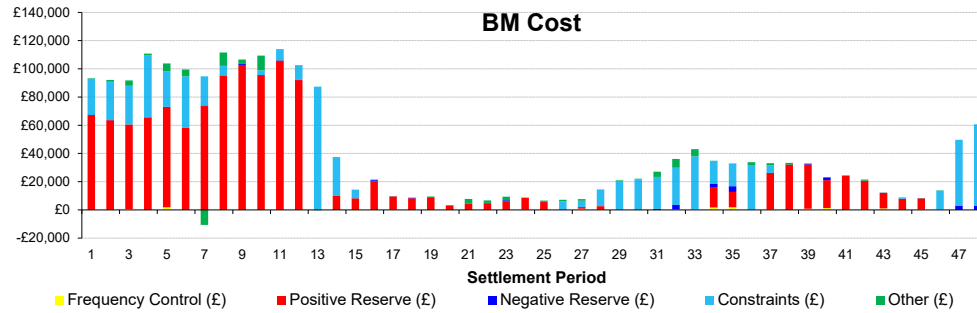

Commentary

The market alternated between long and short throughout the day. Trades were required for Downward Regulation BM Actions were required to manage thermal constraints in England and Scotland. Trades and BM Actions supported Voltage Control. Further BM Actions were required for System Inertia.