



Date: Tuesday 09 Dec 2025

BSUoS Final Tariff: £15.69/MWh
Total Outturn: £10.77m




Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

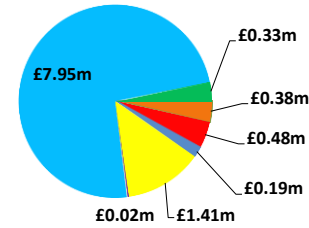

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

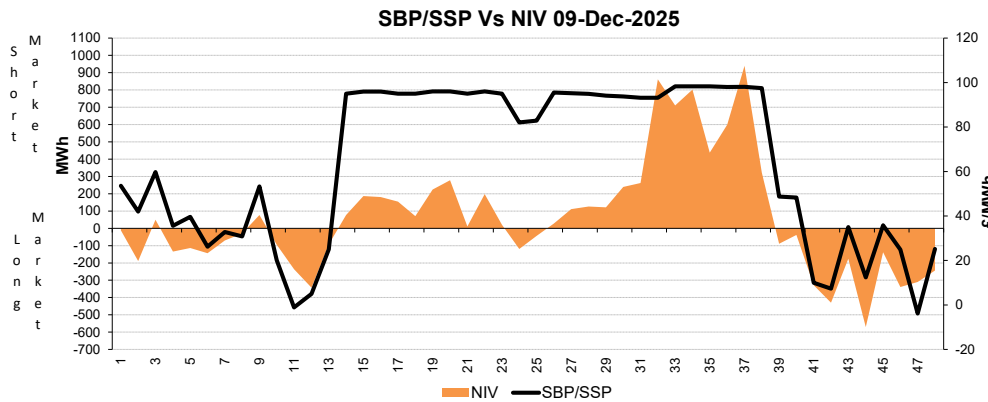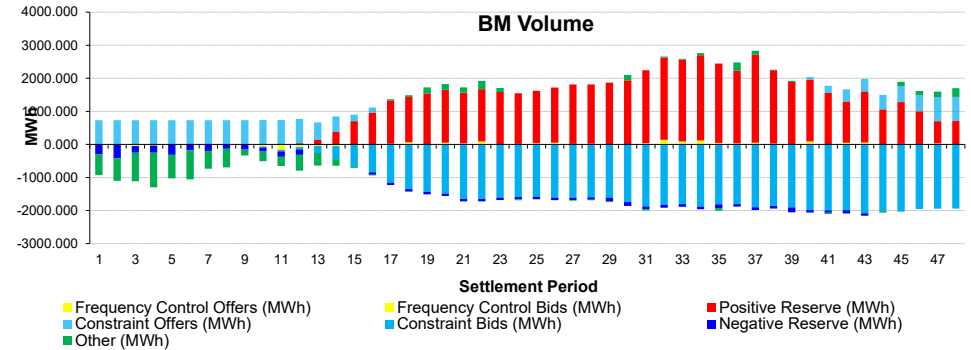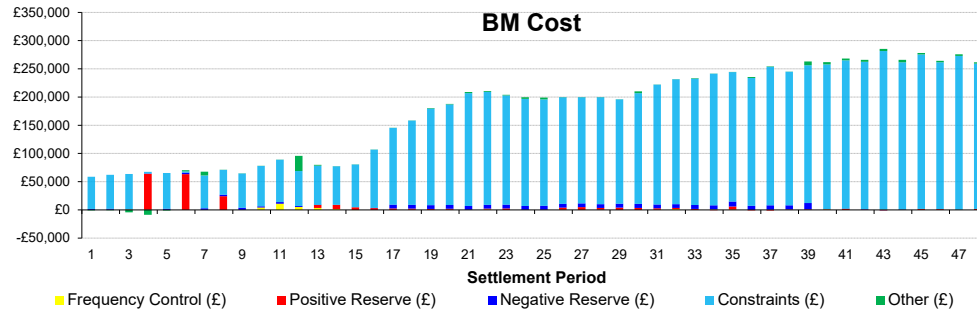

Commentary

The market alternated between long and short throughout the day. Trades were required for Downward Regulation BM Actions were required to manage thermal constraints in England and Scotland. Trades and BM Actions supported Voltage Control. Further BM Actions were required for System Inertia.