






Date: Wednesday 24 Dec 2025

BSUoS Final Tariff: £15.69/MWh

Total Outturn: £3.33m

Daily Balancing Costs

NESO
National Energy System Operator

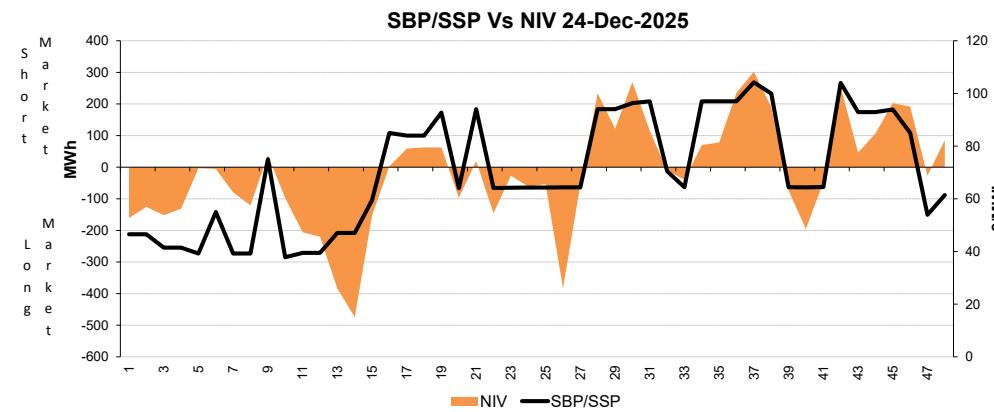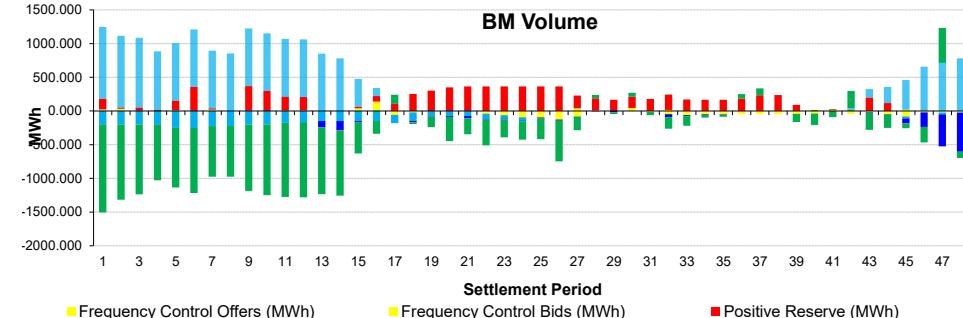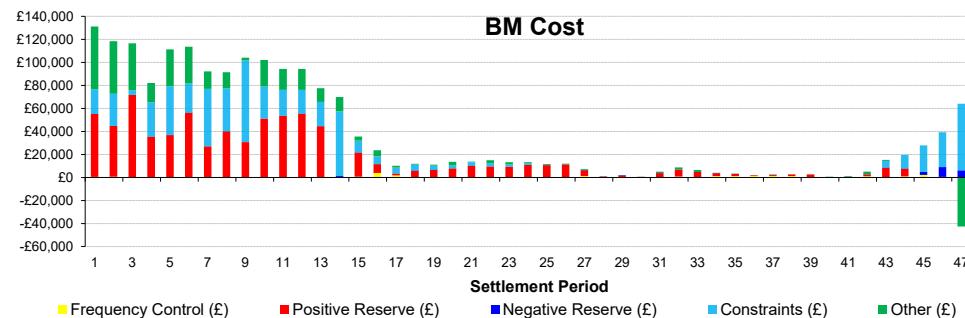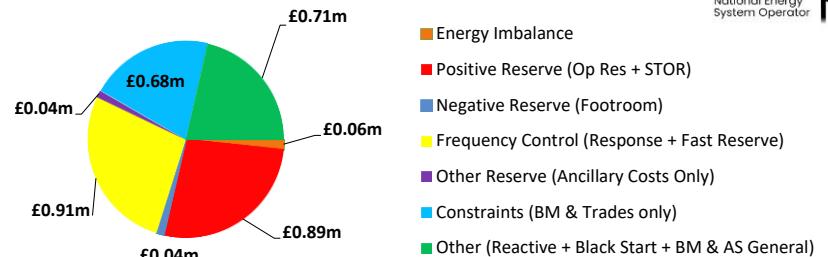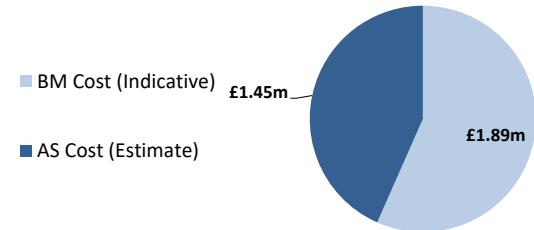

Commentary

The market alternated between long and short throughout the day. Trades were required for Downward Regulation. Trades helped to manage thermal constraints in southern England during the first half of the day. Trades and BM Actions supported Voltage Control and further BM Actions supported System Inertia.

Settlement Period 47 - Please note SP47 contains data from a SO-SO trade which should be spread over the subsequent settlement periods

Public