

Date:

Tuesday 23 Dec 2025






BSUoS Final Tariff: £15.69/MWh

Total Outturn: £2.03m

Daily Balancing Costs

NESO
National Energy
System Operator

- BM Cost (Indicative)
- AS Cost (Estimate)

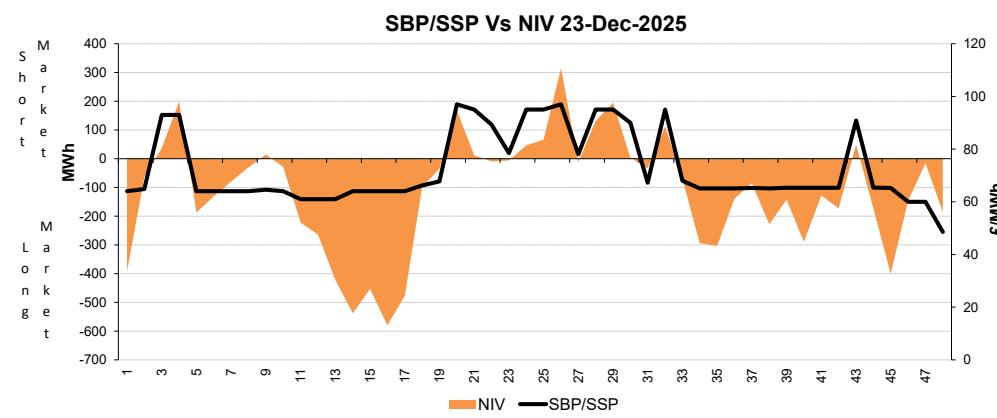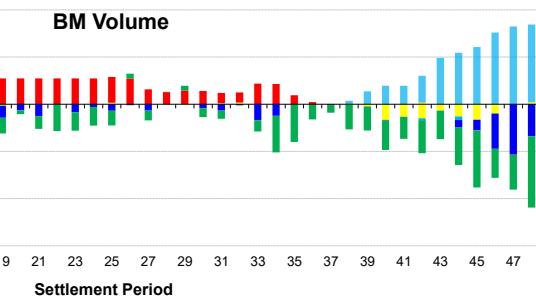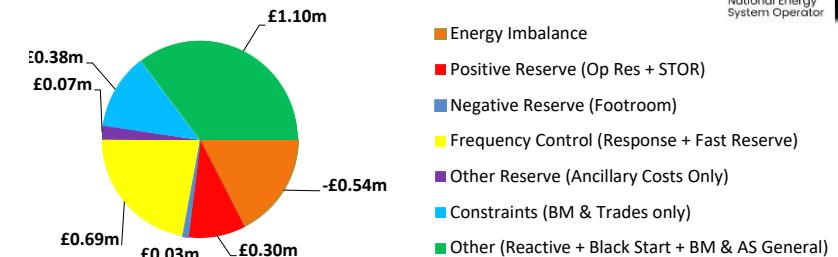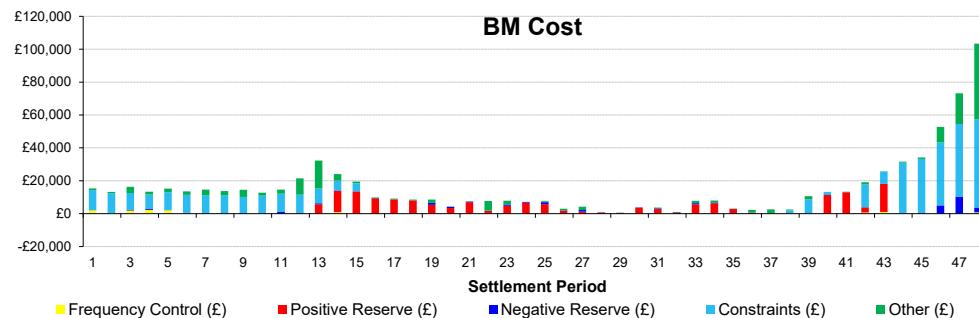

Commentary

The market alternated between long and short throughout the day. No trades were taken for Margin or Downward Regulation.

BM Actions managed thermal constraints in Scotland at the start of the day. Trades managed thermal constraints in England at the end of the day. Trades and BM Actions supported voltage control, and further BM Actions supported System Inertia.

Public