






Date:

Sunday 21 Dec 2025

BSUoS Final Tariff: £15.69/MWh

Total Outturn: £6.10m

Daily Balancing Costs

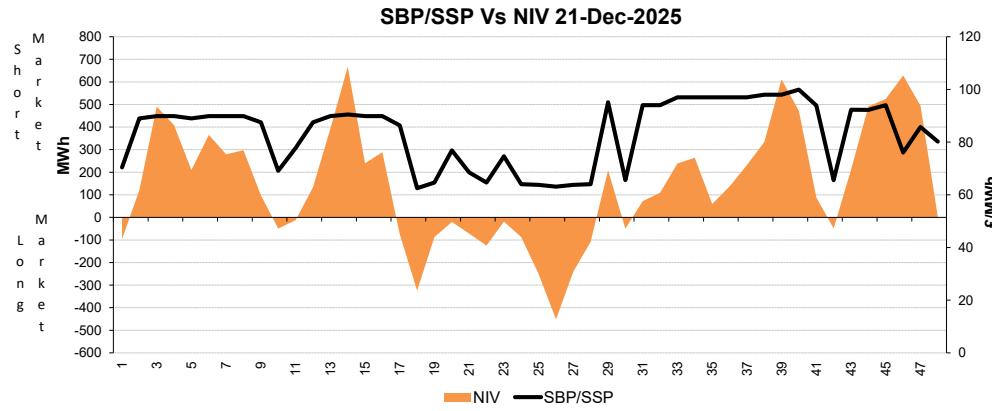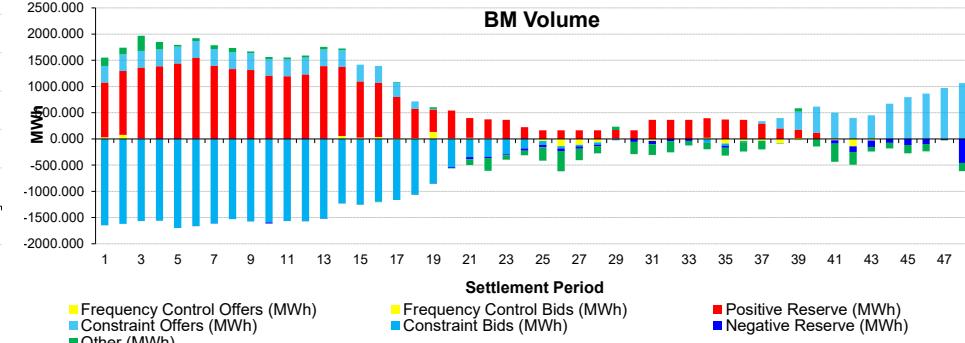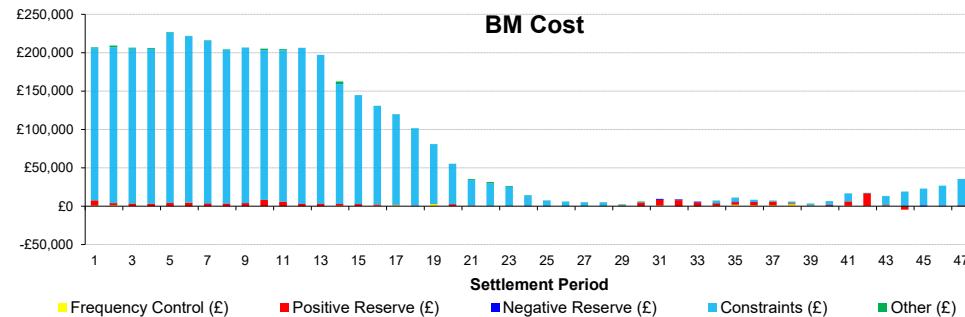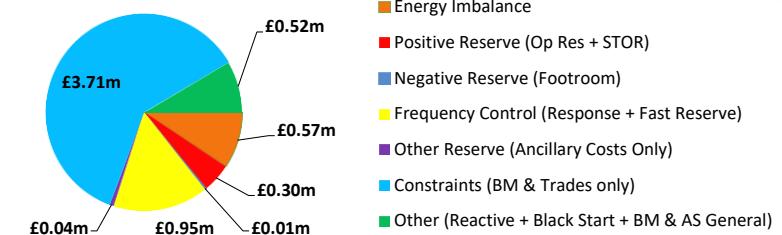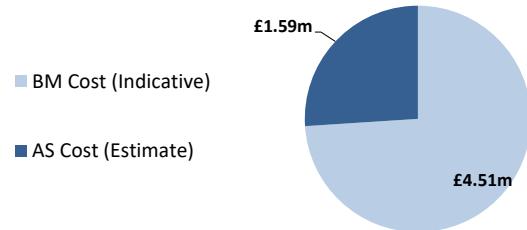

Commentary

The market alternated between long and short throughout the day. Trades were required for Downward Regulation. BM Actions were required to manage thermal constraints in Scotland and Northern England until afternoon. Trades and BM Actions also supported Voltage Control and further BM Actions supported System Inertia.

Public