


Public

Power Available Summary Report

Date Range: January **2026**

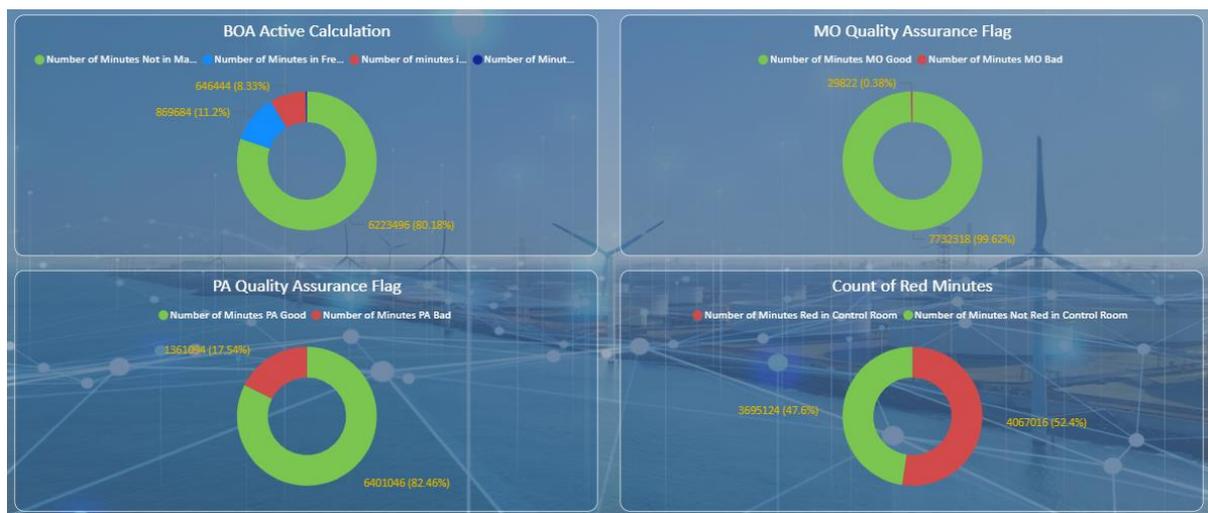

Commentary:

- From the perspective of BMUs, the PA quality assurance flag was approximately 82% and the percentage of red minutes seen in the control room was approximately 52%
- 39 Good BMUs, 33 Moderate BMUs and 102 Poor BMUs
 - o Good: Percentage of minutes not Red of individual BMU $\geq 90\%$
 - o Moderate: Percentage of minutes not Red of individual BMU between 70% and 89%
 - o Poor: Percentage of minutes not Red of individual BMU less than 70%

